

RUSSIAN MARITIME REGISTER OF SHIPPING

RULES

FOR THE CLASSIFICATION AND CONSTRUCTION OF SEA-GOING SHIPS

PART XV

AUTOMATION



Saint-Petersburg
Edition 2016

Rules for the Classification and Construction of Sea-Going Ships of Russian Maritime Register of Shipping have been approved in accordance with the established approval procedure and come into force on 1 January 2016.

The present nineteenth edition of the Rules is based on the eighteenth edition (2015) taking into account the additions and amendments developed immediately before publication.

The unified requirements, interpretations and recommendations of the International Association of Classification Societies (IACS) and the relevant resolutions of the International Maritime Organization (IMO) have been taken into consideration.

The Rules are published in the following parts:

Part I "Classification";

Part II "Hull";

Part III "Equipment, Arrangements and Outfit";

Part IV "Stability";

Part V "Subdivision";

Part VI "Fire Protection";

Part VII "Machinery Installations";

Part VIII "Systems and Piping";

Part IX "Machinery";

Part X "Boilers, Heat Exchangers and Pressure Vessels";

Part XI "Electrical Equipment";

Part XII "Refrigerating Plants";

Part XIII "Materials";

Part XIV "Welding";

Part XV "Automation";

Part XVI "Hull Structure and Strength of Glass-Reinforced Plastic Ships and Boats";

Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships";

Part XVIII "Common Structural Rules for Bulk Carriers and Oil Tankers". The text of the part is identical to that of the IACS Common Structural Rules.

Parts I to XVII are published in electronic format and hard copy in Russian and English. In case of discrepancies between the Russian and English versions, the Russian version shall prevail.

Part XVIII is published in English and in electronic format only.

As compared to the previous edition (2015), the nineteenth edition contains the following amendments.

The term "ice category" has been replaced by the term "ice class" throughout the text of the Rules.

RULES FOR THE CLASSIFICATION AND CONSTRUCTION OF SEA-GOING SHIPS

PART XV. AUTOMATION

1. Section 4: the requirement on mandatory availability of automated bilge plants in the bilge wells has been deleted based on the experience of technical supervision and application of the Rules (paras 4.7.1 and 4.10.3 have been amended, new para 4.9.5 has been introduced).

2. Chapter 8.4: para 8.4.1 has been supplemented with the requirement for submitting the Failure Mode Effects Analysis (FMEA) at the stage of DP-system manufacture on ships with **DYNPOS-2**, **DYNPOS-3** marks in the class notation.

3. Chapter 8.5: in para 8.5.8 the requirement of the redundancy of thrusters with their local control systems for Class 1 DP-systems has been deleted.

4. Editorial amendments have been made.

CONTENTS

PART XV. AUTOMATION

1	General	5	6.3	Equipment arrangement in machinery spaces	27
1.1	Application	5	6.4	Devices in engineers' accommodation	27
1.2	Definitions and explanations	5	7	Computers and computer-based systems	28
1.3	Scope of surveys	5	7.1	Application	28
1.4	Technical documentation	6	7.2	Definitions and explanations	28
2	Design of automation systems, automation components and control devices	7	7.3	General requirements for the design of computer systems used for control and monitoring	28
2.1	General	7	7.4	Hardware requirements	29
2.2	Requirements to components and devices	8	7.5	Software requirements	29
2.3	Automated control systems	8	7.6	System configuration requirements	29
2.4	Alarm and monitoring, safety, indication and logging systems	9	7.7	User interface	30
3	Power supply of automation systems	13	7.8	Training	30
3.1	General	13	7.9	Testing	31
4	Ships with AUT1 in class notation	14	7.10	Programmable electronic systems	31
4.1	General	14	8	Dynamic positioning systems	36
4.2	Automated main machinery and propellers	14	8.1	Application and marks in class notation	36
4.3	Automated boiler plants	19	8.2	Definitions and explanations	36
4.4	Automated electric power plants	20	8.3	Scope of surveys	36
4.5	Automated compressor plants	20	8.4	Technical documentation	37
4.6	Automated pumping units	23	8.5	Design of the DP-system, classes	37
4.7	Automated bilge pumping of machinery spaces	23	8.6	Electric power plant system	38
4.8	Automated refrigerating plants	23	8.7	Thrusters system	38
4.9	Equipment arrangement on the bridge	23	8.8	Control stations	39
4.10	Equipment arrangement in machinery spaces	23	8.9	Computer-based control systems	39
4.11	Devices in engineers' accommodation	24	8.10	Position reference systems	40
5	Ships with AUT2 in class notation	25	8.11	External force sensors	40
5.1	General	25	8.12	Alarm and monitoring system	40
5.2	Equipment arrangement on the bridge	25	8.13	Cable routeing and piping of DP-system machinery and devices	40
5.3	Equipment arrangement in machinery spaces	25	9	Position mooring systems	42
5.4	Electric power plants	25	9.1	Scope of application	42
5.5	Bilge systems of machinery spaces	25	9.2	Definitions and explanations	42
6	Ships with AUT3 in class notation	26	9.3	Control systems	42
6.1	General	26	9.4	Auxiliary thrusters for anchoring systems	42
6.2	Equipment arrangement on the bridge	27			

PART XV. AUTOMATION

1 GENERAL

1.1 APPLICATION

1.1.1 The requirements of Sections 1, 2, 3, 7 apply to automation equipment subject to survey irrespective of whether the ship has an automation mark in the class notation or not.

The requirements of Sections 4, 5, 6 also apply to ships, which have one of the automation marks added to the character of classification in conformity with 2.2.6, Part I "Classification".

1.1.2 The present Part contains technical requirements for the automation equipment and ships, in which it is installed and defines the extent of remote automated control, protection, alarming and indication.

1.1.3 For ships with electric propulsion plants and ships with nuclear propulsion plants, the level of automation to grant the automation mark in the class notation is subject to special consideration by the Register in each case.

1.2 DEFINITIONS AND EXPLANATIONS

1.2.1 Definitions and explanations relating to the general terminology of the Rules are given in Part I "Classification".

For the purpose of the present Part the following definitions have been adopted.

Automated machinery plant is a complex of machinery and equipment fitted up with an automation system.

Uninterruptible power supply is a device supplying output power in some limited time period after loss of main and/or emergency input power with no interruption of the output power.

Acknowledgement is a confirmation of receipt of an alarm or call.

Group alarm subsystem is the structural part of the centralized alarm and monitoring system comprising individual additional blocks (panels) wherein some alarms derived from the combining (grouping) of alarms relating to individual machinery and arrangements into one common alarm are concentrated.

The group alarm shall be named after the item to be monitored, e.g. "main engine", "electric power plant", etc.

The group alarm blocks are arranged in accommodation, service and other spaces where the responsible personnel (chief engineer, watch engineers, electrician engineer, etc.) may be present.

Standby power source is a source of electric power independent of the ship main and emergency power sources.

Alarm and monitoring system is equipment for signalling whenever the controlled parameters reach the preset limit values or deviations of machinery and associated systems from normal working ranges occur. Individual alarms may be grouped in common alarms.

Automation system is equipment intended for an automatic and/or automated control, regulation, monitoring, signalling and protection of machinery or systems.

Remote automated control system is equipment intended for control of machinery from a remote control station enabling an automatic execution of intermediate operations for collection and processing of information on the object and making commands to the executive devices realizing the mode of the machinery functioning set up by the operator.

Safety system is equipment to automatically influence, in a specific way, the operation of machinery under control in order to prevent an emergency or limit its consequences.

Indication system is equipment providing information on the values of certain physical parameters and certain conditions in machinery.

Automation device is a part of automation system comprising components, which form a structural and functional unity.

Automation component is a structurally independent item (e.g. sensor, relay, logic element) forming part of automation devices and systems.

1.3 SCOPE OF SURVEYS

1.3.1 General provisions concerning classification procedure, survey of ships being designed or constructed, manufacture of equipment and items shall be found in Part I "Classification" and General Regulations for the Classification and Other Activity.

1.3.2 Subject to survey during manufacture are automation components, apparatus and control devices of the following:

- .1 main machinery and propellers;
- .2 electric power plants;
- .3 auxiliary machinery;
- .4 main and auxiliary boilers;
- .5 refrigerating plants;
- .6 alarm and monitoring systems;
- .7 safety devices;
- .8 other systems as required by the Register.

1.4 TECHNICAL DOCUMENTATION

1.4.1 For the automation equipment listed under 1.3.2, the technical documentation to be submitted to the Register depending on the object of survey, is as follows:

- .1** functional description including technical parameters and operating conditions;
- .2** block diagram of control system;
- .3** functional process diagram with indication of all instruments and control devices;
- .4** general arrangement and layout;
- .5** user interface description showing the physical layout, a list of all alarms, functions to allocated each keyboard/screen;
- .6** power supply arrangement and connection diagram;

.7 cable routing layout diagram;

.8 instrument and equipment list with indication of performance specifications;

.9 description of functions covered by software and test program for application software at manufacturer's;

.10 schematic diagrams of input and output circuits;

.11 failure mode description;

.12 test program;

.13 operation manual;

.14 installation and maintenance manual.

1.4.2 The technical documentation of equipment shall be submitted to the Register for consideration prior to ship construction in the number as stipulated in 3.2.9, Part I "Classification".

2 DESIGN OF AUTOMATION SYSTEMS, AUTOMATION COMPONENTS AND CONTROL DEVICES

2.1 GENERAL

Table 2.1.6

Parameter	Deviation from nominal value		
	Long-term, %	Short-term	
		%	Time, s
Voltage (a. c.)	+6...–10	±20	1,5
Frequency	±5	±10	5
Voltage (d. c.)	±10	5 10	Cyclic deviation Ripple

2.1.1 Reliable operation of automation systems, automation components and control devices shall be ensured under the following ambient temperature conditions:

- 0 °C to +45 °C in enclosed spaces;
- 25 °C to +45 °C on open deck.

Electronic components and devices to be fitted in distribution boards, control panels or enclosures shall reliably operate at ambient temperatures up to +55 °C.

No damage to automation systems, automation components and control devices shall be caused by temperatures up to +70 °C.

2.1.2 Reliable operation of automation systems shall be ensured at relative air humidity of $(75 \pm 3)^\circ$ per cent and temperature of $(45 \pm 2)^\circ$ C or at relative air humidity of $(80 \pm 3)^\circ$ per cent and temperature of $(40 \pm 2)^\circ$ C, as well as at relative air humidity of $(95 \pm 3)^\circ$ per cent and temperature of $(25 \pm 2)^\circ$ C.

2.1.3 Reliable operation of automation systems shall be ensured at vibrations having a frequency of 2 to 100 Hz, namely, with shift amplitude of ± 1 mm where the vibration frequency is between 2 and 13,2 Hz, and with an acceleration of $\pm 0,7g$ where the vibration frequency is between 13,2 and 100 Hz.

Reliable operation of automation systems mounted upon vibration sources (diesels, compressors, etc) or installed in steering flats shall be ensured at vibration frequencies of 2 to 100 Hz, namely, with a shift amplitude of $\pm 1,6$ mm where the frequency is between 2 and 25 Hz, and with an acceleration of $\pm 4,0g$ where the frequency is between 25 and 100 Hz.

2.1.4 Reliable operation of automation systems shall be ensured at long-term heel up to $22,5^\circ$ and at motions of $22,5^\circ$ with a period of (8 ± 1) s.

2.1.5 The protection of automation systems, automation components and control devices shall be chosen in accordance with 2.4, Part XI "Electrical Equipment" proceeding from their location.

2.1.6 Electrical and electronic components and devices shall operate reliably in case of deviation of the power parameters listed in Table 2.1.6 from nominal values.

Automatic equipment supplied from accumulator batteries shall operate reliably with the following voltage variations from the nominal value:

from +30 to –25 per cent for the equipment, which is not disconnected from the battery during battery charging;

from +20 to –25 per cent for the equipment, which is disconnected from the battery during battery charging.

The operability of automation systems shall not be affected by three successive power supply interruptions during 5 min with switching-off time of 30 s in each case.

2.1.7 Pneumatic and hydraulic components and devices shall be operable under variations of the working medium pressure within ± 20 per cent of the nominal value.

2.1.8 Provision shall be made to ensure the electromagnetic compatibility of automation equipment as specified in 2.2, Part XI "Electrical Equipment" and to keep the radio interference from it to a permissible level.

2.1.9 Automation equipment shall operate reliably in case of harmonic distortions of the supply voltage curve as specified under 2.2.1.3, Part XI "Electrical Equipment".

2.1.10 Components and devices to be installed in locations with specific operating conditions (high or low temperature, excessive mechanical loads, etc) shall be designed and tested with regard to the conditions.

2.1.11 Automation equipment shall be made of materials resistant to marine environment or shall be reliably protected from its harmful effect.

2.1.12 Automation systems shall comprise arrangements to preclude false alarms from momentary changes of parameters due to roll of the ship, machinery switch-on and switch-off, etc.

2.1.13 Automation systems shall be based on the "fail-to-safe" principle.

2.1.14 The list of spare parts for automation equipment and systems is made up by the manufacturer.

For a particular ship, the total number of spare parts is determined on the basis of agreement between the shipbuilder and equipment manufacturer on one part and the shipowner on the other with due regard to the equipment reliability.

2.2 REQUIREMENTS TO COMPONENTS AND DEVICES

2.2.1 The components and devices of automation systems shall additionally comply with the applicable parts of the Rules.

2.2.2 Replaceable components, which require adjustment, as well as check-up points (terminals, monitoring jacks) shall be so arranged that easy access is possible at any time.

2.2.3 The devices shall be capable of being tested during normal operation.

2.2.4 Equipment shall preferably function without forced cooling. Where such cooling is indispensable, precautions shall be taken to prevent the equipment from being damaged in the event of failure of the cooling unit.

2.2.5 Setting components shall be protected against spontaneous change of setting. Such protection shall not preclude the possibility of adjustment.

2.2.6 Actuators shall be so constructed that no spontaneous change of their setting is possible.

2.2.7 Sensors used for measuring temperature of fire-hazardous, toxic liquids, vapours and gases, liquids, vapours and gases under pressure shall be isolated from the medium tested.

2.2.8 Provision shall be made for checking and calibrating of the pressure transducers at their connections to the test points, without dismantling.

2.2.9 All units, devices and test points shall be clearly and permanently marked. The marking shall be preferably placed adjacent to them.

2.2.10 Electrical and electronic equipment.

2.2.10.1 The contacting connections shall be so designed as to prevent the increase of contact resistance restricting the equipment performance.

2.2.10.2 At cable and wire inlets, especially in way of connections to movable elements and devices, provision shall be made to avoid tension effects.

2.2.10.3 Printed circuit boards shall be coated with insulating varnish.

2.2.10.4 Provision shall be made to prevent incorrect mounting of removable items (modules) having plug-and-socket connections and to ensure their efficient fixing in the working position. Where necessitated by the operating or structural features of components or devices, their position assuring proper mounting shall be clearly marked or, alternatively, they shall be so constructed that the possibility of being mounted in a wrong position is excluded.

2.2.11 Hydraulic and pneumatic equipment.

2.2.11.1 Hydraulic and pneumatic components and devices shall not be damaged by overloads due to a working medium pressure rise equal to 1,5 times the working pressure.

2.2.11.2 The fluids of hydraulic systems shall retain their physical properties under all possible operating conditions, to possess good lubricating properties and a vapour flash point not less than 60 °C, not to cause the damage to components and piping and not to be toxic.

2.2.11.3 Hydraulic automation equipment shall not be connected with other systems and shall be supplied from separate tanks. On agreement with the Register, the use of fluid from other systems may be permitted for actuating systems subject to provision of filtering arrangements.

2.2.11.4 Connections of the outlet pipes shall be located below the working fluid level in the tanks under any operating conditions of the ship.

2.2.11.5 Pneumatic automation systems shall have arrangements to ensure the required degree of cleanliness and dryness of the air.

2.2.11.6 Pneumatic automation systems of the main propulsion plants and electrical power plants shall generally have two devices for cleaning and drying the air interconnected in such a way that one of them remains operative while the other is cut off.

A single air cleaning and drying device may be permitted where automatic cleaning is provided or its design is such that a rapid replacement of filtering elements is possible without interruption of the air supply.

2.2.11.7 The feeding pipes of pneumatic automation systems shall be fitted up with safety valves set to operate when the nominal working pressure is exceeded by more than 10 per cent. Reducing valves, if any, shall be duplicated.

2.2.11.8 Where hydraulic, pneumatic and electronic or electric elements and devices are combined in desks, cabinets or cubicles, they shall be effectively separated so that eventual leaks from pipes and hoses and from their connections would not damage such elements and devices.

Desks, cabinets and cubicles accommodating equipment, which contains working fluid, shall be fitted up with appliances for collection and retrieval of the leaks.

2.3 AUTOMATED CONTROL SYSTEMS

2.3.1 Machinery and plants shall be constructed in conformity with the applicable requirements of the relevant parts of the Rules, and equipped with local control stations.

2.3.2 Automated control shall keep all controlled parameters within the limits specified by the normal operating conditions of the machinery and plants under control.

2.3.3 The automated control shall be stable over the entire control range. The margin of stability shall be sufficient to ensure that variations in the controlled parameters that may be expected under normal conditions will not cause instability.

2.3.4 Machinery and plants, which can be started automatically or remotely, shall be fitted up with devices at local control stations to switch off the automatic or remote control, respectively.

In case of automatic or remote control failure, local control is still to be possible.

2.3.5 Changeover from local control mode to automatic or remote control mode shall be possible from local control stations only. Changeover from remote to automatic control mode may be effected from remote control stations.

2.3.6 If the preset sequence of operations is disturbed, the automated control system shall stop performing the program and shall bring the machinery to a safe condition with an alarm given at all cases at the permanently attended control station.

2.3.7 The starting system of powerful consumers of electrical power, the switching on of which may result in the inadmissible loss of voltage or the main switchboard busbars failure, shall provide for the following:

preliminary automatic start of the standby generator, synchronization, load acceptance and distribution; or

interlocking device preventing the switching on of such consumers prior the standby generator switching to the main switchboard busbars, and the appropriate indication.

2.4 ALARM AND MONITORING, SAFETY, INDICATION AND LOGGING SYSTEMS

2.4.1 Alarm and monitoring system.

2.4.1.1 The alarm and monitoring system shall be independent of control systems and safety devices, i.e. it shall not be affected by malfunction or failure of such devices.

Possibility of partial integration of these systems is subject to special consideration of the Register in each case.

2.4.1.2 Provision shall be made for the self-monitoring of the alarm and monitoring system; the alarm signal shall be applied in the case of at least such typical faults as short-circuits, open-circuit failure and earth fault, and the failure of the power supply.

2.4.1.3 The alarm and monitoring system shall give visual and audible signals simultaneously. In this case the possibility of simultaneous indication of more than one fault shall be provided. The acknowledgement of one signal shall not prevent the entry of

another. The failure of one component (device) of the system shall not cause failure of the alarm and monitoring system in general. When common monitors are applied instead of individual light signalling devices, at least two such monitors shall be provided.

2.4.1.4 The alarm and monitoring system with its central information panels usually arranged in the main machinery control room shall structurally include the group alarm subsystem, which blocks shall be located:

in machinery spaces (light columns);

on the navigation bridge (in the wheelhouse);

in service and public spaces of a ship;










in accommodation spaces of the responsible personnel.

The switching-off of an audible alarm signal on the group alarm blocks (e.g. on the navigation bridge or in accommodation spaces) shall not cause its switching-off in the main machinery control room.

2.4.1.5 In machinery spaces, along with the audible signal devices of the alarm and monitoring system provision shall be made for visual devices (light columns) for the signal identification, for which colours and symbols shown in Table 2.4.1.5 shall be used.

Visual indicators shall be clearly visible and distinguishable either directly or by reflection in all parts of the spaces in which light columns are

Table 2.4.1.5

Signal	Colour	Symbol
Fire detection and fire alarm in spaces other than machinery spaces	Red	
Machinery spaces fire detection and fire alarm	Red	
Release indication of fire smothering system	Red	CO ₂ ^{1,2}
Alarm	Yellow	
Steering gear alarm	Yellow	
Bilge alarm	Yellow	
Engineers' alarm	Yellow	
Telephone	White	
Engine-room telegraph. Command transmission	White	
Release indication of fixed local application fire extinguishing system	Red	 w

¹Extinguishing media other than CO₂ shall be specified.

²For water mist fire-extinguishing systems in machinery spaces of category A and cargo pump-rooms specified in 3.4.1 of Part VI "Fire Protection", instead of signal warning of putting the fire-extinguishing system into action the alarm on activation of valves on the distribution pipes (red colour, symbol "W" or "WATER MIST") shall be provided.

required, flash in accordance with 2.4.1.7, be of high luminous intensity. When visibility and distinctiveness in the space cannot be provided by one light column, several columns shall be installed. Instead of individual flashing lights a single flash or rotating white light in addition to a permanent individual indication may be used for light columns.

2.4.1.6 In spaces with high ambient noise levels, additional audible and visual (flashing or rotating light) signal devices shall be installed.

2.4.1.7 The visual signals shall indicate the fault condition resulted in alarm operation and are generally to flash. The flashing alarm shall be illuminated for at least 50 per cent of the cycle and have a pulse frequency in the range of 0,5 and 1,5 Hz.

2.4.1.8 Alarms at workstations shall normally be acknowledged in two steps:

switch-off audible signal and additional visual signal (e.g. rotating light signals, etc) leaving the visual signal on the workstation unchanged;

acknowledgment of the visual alarm on the workstation. After being accepted, the flashing light shall change to steady condition.

Cancelling of a visual signal shall only be possible after the abnormal condition has been corrected.

2.4.1.9 Self-eliminating faults shall be indicated by the alarm and monitoring system in such a way that the signal remains applied until it is accepted.

2.4.1.10 Checking of the alarm and monitoring system shall be possible while machinery in operation.

2.4.1.11 Irrespective of the extent of automation and the monitoring order used for the machinery, the alarm and monitoring system shall give warning signals at:

- .1 parameters reaching predetermined limit values;
- .2 operation of safety devices;
- .3 power failure in the circuits of particular automation systems or start of emergency power sources;
- .4 deviation from predetermined values of other parameters or operating conditions as regulated by the present Part.

Alarms for machinery faults shall be provided on the panels, from which the machinery is remotely controlled.

2.4.1.12 The alarm and monitoring system shall be so arranged that signals not pertinent to navigation and navigational situation are in the first place relayed to the panels in machinery spaces and main machinery control room, as well as to group alarm device in the accommodation, service and public spaces, in which the members of machinery crew might be staying. Then, if the signals are not acknowledged within a specified period of time (e.g. 2 min), they shall be directed to the navigation bridge.

2.4.1.13 The engineers' alarm referred to in 7.8.1, Part XI "Electrical Equipment" shall be additionally activated automatically where an alarm for machinery plant is not acknowledged at the place of its destination within a specified period of time to be determined by the ship's size but not exceeding 5 min.

2.4.1.14 The personnel alarm referred to in 7.9.1, Part XI "Electrical Equipment" shall be additionally activated automatically when the engineer on duty has to attend machinery space in case of a machinery alarm. Acknowledgement of the personnel alarm shall not be possible before the engineer has acknowledged the alarm in the machinery space.

2.4.1.15 Manual blocking of separate alarms shall be clearly indicated at the workstation.

2.4.1.16 Blocking of alarm and safety functions in certain operating modes of machinery (e.g. during start-up) shall be automatically disabled in other modes.

2.4.1.17 The audible signals of the alarm and monitoring system shall be readily distinguishable from audible signals of other systems. The audible signals shall have a frequency from 200 up to 2500 Hz. Provision may be made for means to adjust the frequency of audible signals within the range specified above. The waveform of audible signal released by alarm and monitoring system shall correspond to one of the waveforms shown in Table 2.4.1.17. The sound pressure level at a distance of 1 m from the sound source shall be not lower than 75 dB and more than by 10 dB higher than the ambient noise existing during the normal functioning of the equipment with the ship underway under moderate weather conditions. The sound pressure level in a space shall not exceed 120 dB. The sound pressure level shall be measured within the frequency band of 1/3 octave with respect to the frequency of the first harmonic of the signal. To ensure that the signal can be properly heard in large spaces and in spaces with high level of ambient noise, several audible signal units shall be installed. The audible signal of the alarm and monitoring system shall be clearly heard even though one of the signal display units fails.

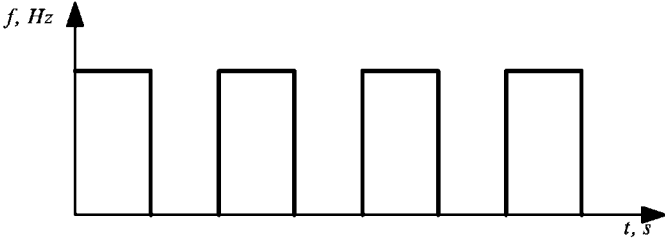
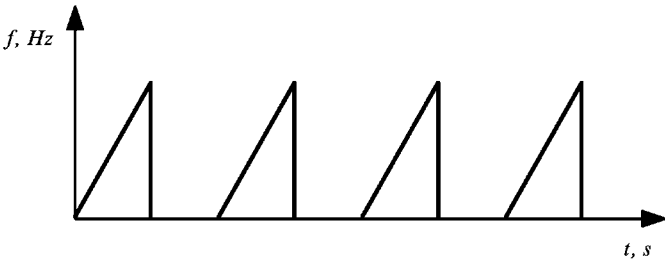
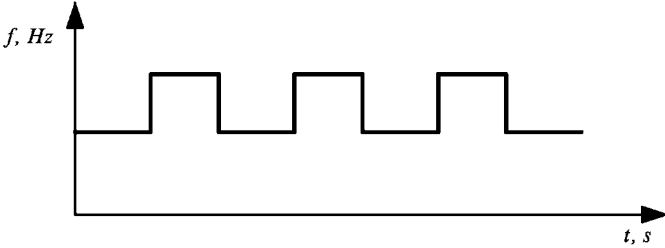
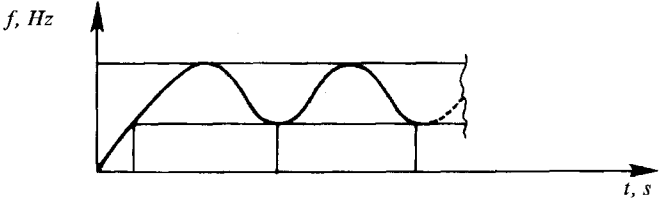
2.4.2 Safety systems.

2.4.2.1 The safety system shall be activated automatically at faults that could involve an emergency condition of machinery or equipment in order to:

- .1 restore normal operating conditions (by starting standby units);
- .2 temporarily adjust the operation of machinery to the prevailing conditions (e.g. by reducing the load upon the machinery);
- .3 protect machinery from emergency condition by stopping the machinery.

Table 2.4.1.17

Waveforms of audible signals of the alarm and monitoring system

Nos	Waveform
1	
2	
3	
4	

Automatic stopping of main machinery shall be executed only in cases of deviation of those parameters, which could lead to serious damage, complete breakdown or explosion.

A safety system shall include an indicator to show the parameter, for which the system was put into operation.

2.4.2.2 The safety systems arranged to shut down the machinery shall be independent of control and alarm systems including sensors so that the faults and failures of those systems including their supply systems would not influence the safety systems.

Where arrangements for overriding the shutdown of machinery are fitted, these shall be such as to preclude inadvertent operation. Light signal shall be provided on the machinery control panel to indicate when the override has been activated.

2.4.2.3 Provision shall be made for the self-monitoring of the safety systems: at least at such faults as short-circuit, open-circuit failure and earth fault an alarm signal shall be activated.

2.4.2.4 The safety systems of particular machinery and plants shall be independent of each other so that a failure in the safety system of certain

machinery or plant would not affect the operability of the safety systems of the rest of the machinery and plants.

2.4.2.5 When the safety system stops the machinery, the machinery shall not start again automatically while the emergency condition is corrected.

2.4.2.6 Provision protection be made within the automatic safety system of the main machinery (propulsion plant) for the alarm to warn of the forthcoming inevitable activation of the safety system for slowdown or shutdown propulsion so that the watch officer has an opportunity and sufficient time to assess navigational situation and in an emergency, if necessary, to counteract the activation of the safety system except for those cases when manual intervention will result in total failure of the main machinery within a short time, for example in the case of overspeed.

2.4.3 Indication and logging systems.

2.4.3.1 Indications sufficient to allow safe operation of essential and important functions shall be installed at all control locations from where the function shall be accomplished. Alarms shall not be considered as substitutes for indications for this purpose.

2.4.3.2 Indication and logging systems shall be independent of any other systems so that their failure would not affect such other systems.

2.4.3.3 When logging systems fail, the alarm signal shall be activated.

2.4.3.4 Provision shall be made for easy reading of indicated data with regard to the illumination at the locations of indicators.

2.4.3.5 Provision shall be made for displaying the readings of indication systems in units normally used for the parameters, i.e. without recalculation.

3 POWER SUPPLY OF AUTOMATION SYSTEMS

3.1 GENERAL

3.1.1 Where automated units shall be supplied from both the main and emergency power sources, the automation systems shall also be supplied from these two power sources independent of each other.

3.1.2 The control systems of main machinery shall be supplied by two separate feeders, one of which shall take power from the main switchboard and the other may be connected to the switchboard for essential services or, by way of exception, to the nearest switchboard. The changeover from one feeder to another shall be effected automatically with appropriate signal activated at the control station.

3.1.3 Provision shall be made in the power supply for safety arrangements to allow selective disconnection of failed components.

3.1.4 Where the automation systems of particular auxiliary machinery are supplied by the same feeders as the corresponding electric drives, provision shall

be made for a start of standby unit and for connection of the automation system to its feeder in case of a loss of power at the running unit.

3.1.5 Hydraulic and pneumatic automation systems shall be supplied from two sources. The second source shall be connected automatically upon pressure loss with application of an alarm signal.

The use of starting air for automation systems is permitted, provided the air receivers are filled automatically and the requirements of 2.2.11.5 and 2.2.11.6 are complied with.

3.1.6 Alarm and safety systems shall be supplied from an uninterruptible power source, with an alarm being activated upon loss of its input voltage.

The capacity of the accumulator battery of the said power source shall be sufficient for servicing the alarm and safety systems during at least 30 min.

3.1.7 The controls of generator drives shall be supplied independently of the main switchboard busbars.

4 SHIPS WITH AUT1 IN CLASS NOTATION

4.1 GENERAL

4.1.1 Self-propelled ships and floating facilities with the automation mark AUT1 in class notation shall be equipped with machinery plant automation systems in compliance with the requirements of the Section and to the extent sufficient to ensure their manoeuvrability and safety under all operating conditions without permanent attendance of personnel in machinery spaces and engine control room.

4.1.2 Provision shall be made for an integrated alarm system to cover all the parameters and working conditions under control as mentioned in the Section.

4.1.3 Provisions concerning fire protection shall be found in 4.2.3, Part VI "Fire Protection".

4.1.4 All equipment installed in a machinery space shall be capable of operating in an unattended machinery space and main machinery control room. On agreement with the Register, some operations (replenishment of tanks, cleaning of filters, etc) may be performed manually, if carried out at certain intervals (not more than once every 24 h).

4.2 AUTOMATED MAIN MACHINERY AND PROPELLERS

4.2.1 Provision shall be made for remote automated control system of starting and stopping, as well as of rotational frequency of the main machinery, propeller thrust value and direction within the whole permissible operating range of the propulsion system from the navigation bridge.

4.2.2 Remote automated control system shall meet the following requirements:

.1 automatic attempts, which fail to produce a start, shall be limited so that after the last ineffective attempt the starting air quantity or accumulator battery capacity is sufficient to provide manually a half number of starting attempts as required in 16.1, Part VIII "Systems and Piping" or 13.7.2, Part XI "Electrical Equipment";

.2 the last command given shall be executed regardless of the order sequence and quickness;

.3 setting of the thrust value and direction may be effected by means of a single control unit;

.4 an automatic passing of the critical rotational frequency ranges irrespective of the set-operating mode;

.5 overload of the main machinery in the normal operating modes shall be prevented;

.6 remote automated control systems and engine telegraph systems shall be independent of each other (common control lever may be used);

.7 provision shall be made for signalling to indicate power loss and malfunction of the remote automated control system;

.8 impermissible operating modes of the main machinery and propellers (spontaneous increase of rotational frequency, start and reverse) in the event of failure of the remote automated control system shall be precluded;

.9 emergency manoeuvring shall be ensured within the shortest time possible, and along with that, relevant limitations and protections may be removed.

4.2.3 Where there are several control locations, the one in the main machinery control room shall be predominant over the one on the navigation bridge. The same is true in respect of the local control station of the main machinery as compared to the main machinery control room.

4.2.4 The transfer of control from one control location to another shall be possible from a predominant location only, irrespective whether the controls at the locations are matched or not.

The transfer of control shall be accompanied with audible and visual signals at all the control locations. At the locations, provision shall be made for visual indicators showing from which location control is performed.

4.2.5 The possibility of simultaneous control from different locations shall be eliminated. Use of interconnected controls at one location (e.g. at bridge wings and spaces) may be permissible.

4.2.6 At all the control locations including disconnected ones, provision shall be made for permanent indication of commands transmitted by engine telegraph.

4.2.7 The main engine emergency stop device required by 3.2.1.6, Part VII "Machinery Installations", if electrically operated, shall be independent of the remote automated control system, alarm and monitoring system and of the ship mains.

4.2.8 In case of main internal combustion engine as a propulsion plants, the temperature of the working media listed below shall be automatically adjust within the prescribed limits:

cylinder coolant;

piston coolant;

nozzle coolant;

lubricating oil;

fuel oil (if heavy oil is used and viscosity regulation is not available).

As far as main machinery of other types is concerned, the automatic regulation of working medium temperature shall be agreed with the Register.

4.2.9 With regard to geared diesel plants (two diesels and more), provision shall be made that, with one engine shut down, the others go on running without being overloaded.

4.2.10 Monitored parameters of automated main machinery and propellers, measuring points, limiting values of parameters and types of automatic protection and indication shall be found in Tables 4.2.10-1 to 4.2.10-5.

Table 4.2.10-1

Main internal combustion crosshead engines

Nos	Monitored parameter	Group 1: remote indication, alarm, automatic slowdown with alarm	Group 2: automatic start of stand-by pumps with alarm	Group 3: automatic shutdown of engine with alarm
1	Fuel oil system			
1.1	Fuel oil pressure after filter (engine inlet)	●↓	●	—
1.2	Fuel oil viscosity (temperature) before injection pumps	↑(↓)	—	—
1.3	Fuel oil leakage from high-pressure pipes	○	—	—
1.4	Fuel oil level in daily service tank ¹	↓	—	—
1.5	Common rail fuel oil pressure	Min	—	—
2	Lubricating oil system			
2.1	Lubricating oil to main bearing and thrust bearing pressure	●↓▼	●	×
2.2	Lubricating oil to crosshead bearing pressure ²	●↓▼	●	×
2.3	Lubricating oil to camshaft pressure ²	↓	●	×
2.4	Lubricating oil to camshaft temperature ²	↑	—	—
2.5	Lubricating oil inlet temperature	↑	—	—
2.6	Thrust bearing pads temperature or bearing outlet lubricating oil temperature	↑▼	—	×
2.7	Main, crank, crosshead bearing lubricating oil outlet temperature or oil mist concentration in crankcase ³	↑▼	—	—
2.8	Flow rate cylinder lubricator. Each apparatus	↓▼	—	—
2.9	Level in lubricating oil tank ⁴	↓	—	—
2.10	Common rail servo oil pressure	Min	—	—
3	Turbocharger			
3.1	Turbocharger lubricating oil inlet pressure ⁵	↓	—	—
3.2	Turbocharger lubricating oil outlet temperature of each bearing ⁶	↑	—	—
3.3	Speed of turbocharger	●	—	—
4	Piston cooling system			
4.1	Piston coolant inlet pressure ⁷	↓▼	●	—
4.2	Piston coolant outlet temperature of each piston	↑▼	—	—
4.3	Piston coolant outlet flow of each piston ⁸	↓▼	—	—
4.4	Piston coolant level in expansion tank	↓	—	—
5	Sea water cooling system			
5.1	Sea water pressure	↓	●	—
6	Cylinder fresh cooling water system			
6.1	Cylinder water inlet pressure	↓▼	●	—
6.2	Cylinder water outlet temperature (from each cylinder) or cylinder water outlet temperature (general) ⁹	↑▼	—	—
6.3	Oily contamination of engine cooling water system ¹⁰	○	—	—
6.4	Level of cylinder cooling water in expansion tank	↓	—	—
7	Starting and control air systems			
7.1	Starting air pressure before main shut-off valve	●↓	—	—
7.2	Control air pressure	↓	—	—
7.3	Safety air pressure	↓	—	—
8	Scavenge air system			
8.1	Scavenge air receiver pressure	●	—	—
8.2	Scavenge air box temperature (fire)	↑▼	—	—
8.3	Scavenge air receiver water level	↑	—	—
9	Exhaust gas system			
9.1	Exhaust gas temperature after each cylinder	●↑▼	—	—
9.2	Exhaust gas temperature after each cylinder, deviation from average	↑	—	—
9.3	Exhaust gas temperature before each turbocharger	●↑	—	—
9.4	Exhaust gas temperature after each turbocharger	●↑	—	—
10	Fuel valve coolant			
10.1	Fuel valve coolant pressure	↓	●	—
10.2	Fuel valve coolant temperature	↑	—	—
10.3	Fuel valve coolant level in expansion tank	↓	—	—

Table 4.2.10-1 — continued

Nos	Monitored parameter	Group 1: remote indication, alarm, automatic slowdown with alarm	Group 2: automatic start of stand-by pumps with alarm	Group 3: automatic shutdown of engine with alarm
11	Engine speed/direction of rotation	■	—	—
12	Wrong way	○	—	—
13	Engine overspeed	—	—	×
14	Control, safety and alarm systems power supply failure	○	—	—
15	Gas concentration in machinery spaces ¹¹	↑	—	—
<p>Symbols:</p> <ul style="list-style-type: none"> ● — remote indication; ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; ■ — automatic start of stand-by pumps; ▼ — slowdown; × — engine shutdown. 				
<p>¹High level alarm is also required if not suitable overflow arrangement is provided. ²If separate lubricating oil systems are installed. ³For engines having a power of more than 2250 kW or a cylinder bore of more than 300 mm. ⁴Where separate lubricating oil systems (for camshaft, rocker arms, etc) are installed, individual level alarms shall be provided for each system. ⁵Unless provided with a self-contained lubricating oil system integrated with the turbocharger. ⁶Where outlet temperature from each bearing cannot be monitored due to the engine/turbocharger design alternative arrangements may be accepted. Continuous monitoring of inlet pressure and inlet temperature in combination with specific intervals for bearing inspection in accordance with the turbocharger manufacturer's instructions may be accepted as an alternative. ⁷Slowdown is not required if the coolant is oil taken from the main cooling system of the engine. ⁸Where outlet flow cannot be monitored due to engine design, alternative arrangement may be accepted. ⁹Where one common cooling space without individual stop valves is employed for all cylinder jackets. ¹⁰Where main engine cooling water is used in fuel and lubricating oil heat exchangers. ¹¹Required where installations with dual-fuel (gas — liquid fuel) engines are used.</p> <p>Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 2 parameters — a sensor for automatic start of stand-by pumps; for Group 3 parameters — a sensor of safety system (engine shutdown).</p>				

Table 4.2.10-2

Main internal combustion trunk piston engines

Nos	Monitored parameter	Group 1: remote indication, alarm, automatic slowdown with alarm	Group 2: automatic start of stand-by pumps with alarm	Group 3: automatic shutdown of engine with alarm
1	Fuel oil system			
1.1	Fuel oil pressure after filter (engine inlet)	●↓	●	—
1.2	Fuel oil viscosity (temperature) before injection pumps ¹	↑(↓)	—	—
1.3	Fuel oil leakage from high-pressure pipes	○	—	—
1.4	Fuel oil level in daily service tank ²	↓	—	—
1.5	Common rail fuel oil pressure	Min	—	—
2	Lubricating oil system			
2.1	Lubricating oil to main bearing and thrust bearing pressure	●↓	●	×
2.2	Lubricating oil filter differential pressure	●↑	—	—
2.3	Lubricating oil inlet temperature	●↑	—	—
2.4	Oil mist concentration in crankcase ³	↑	—	×
2.5	Flow rate cylinder lubricator. Each apparatus	↓▼	—	—
2.6	Common rail servo oil pressure	Min	—	—
3	Turbocharger			
3.1	Turbocharger lubricating oil inlet pressure ⁴	●↓	—	—
3.2	Turbocharger lubricating oil outlet temperature, each bearing ⁵	↑	—	—
4	Sea water cooling system			
4.1	Sea water pressure	●↓	●	—
5	Cylinder fresh cooling water system			
5.1	Cylinder water inlet pressure or flow	●↓▼	●	—
5.2	Cylinder water outlet temperature ⁶	●↑▼	—	—
5.3	Level of cylinder cooling water in expansion tank	↓	—	—
6	Starting air and control air systems			
6.1	Starting air pressure before main shut-off valve	●↓	—	—
6.2	Control air pressure	●↓	—	—
7	Scavenge air system			
7.1	Scavenge air receiver temperature	↑	—	—
8	Exhaust gas system			
8.1	Exhaust gas temperature after each cylinder ⁷	●↑▼	—	—
8.2	Exhaust gas temperature after each cylinder, deviation from average ⁷	↑	—	—
9	Engine speed	●	—	—
10	Engine overspeed	—	—	×
11	Control, safety and alarm systems power supply failure	○	—	—
12	Gas concentration in machinery spaces⁸	↑	—	—
Symbols: ● — remote indication; ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; ■ — automatic start of stand-by pumps; ▼ — slowdown; × — engine shutdown.				
¹ For heavy fuel oil burning engines only. ² High level alarm is also required if no suitable overflow arrangement is provided. ³ Only for medium-speed engines having more than 2250 kW or a cylinder bore more than 300 mm. One oil mist detector for each engine having two independent outputs (for initiating the alarm and shutdown) satisfy the requirements for independence between the alarm and shutdown systems. ⁴ Unless provided with a self-contained lubricating oil system integrated with the turbocharger. ⁵ Where outlet temperature from each bearing cannot be monitored due to the engine/turbocharger design alternative arrangements may be accepted. Continuous monitoring of inlet pressure and inlet temperature in combination with specific intervals for bearing inspection in accordance with the turbocharger manufacturer's instructions may be accepted as an alternative. ⁶ Two separate sensors are required for the alarm and slowdown. ⁷ For engines with cylinder output of more than 500 kW. ⁸ Required where installations with dual-fuel (gas — liquid fuel) engines are used.				
Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 2 parameters — a sensor for automatic start of stand-by pumps; for Group 3 parameters — a sensor of safety system (engine shutdown).				

Table 4.2.10-3

Main steam turbines

Nos	Monitored parameter	Group 1: indication, alarm	Group 2: automatic start of stand-by pumps with alarm	Group 3: automatic shutdown of turbine
1	Lubricating oil pressure after oil cooler	●↓	●	×
2	Lubricating oil differential pressure across filter	●↑	—	—
3	Lubricating oil temperature at each bearing outlet	●↑	—	—
4	Lubricating oil level in gravity tank	●↓	—	×
5	Steam temperature before manoeuvring valves ¹	●↑↓	—	—
6	Steam pressure before manoeuvring valves	●↑	—	—
7	Steam pressure in condenser	●↑	—	×
8	Pressure in deaerator	●↑↓	—	—
9	Water level in deaerator	●↑↓	—	—
10	Water level in condenser	●↑↓	—	×
11	Water pressure after condensate pump	●↓	●	—
12	Condensate salinity	↑	—	—
13	Turbine vibration	↑	—	×
14	Axial displacement of rotor	↑	—	×
15	Steam pressure in end glands	●↑	—	—
16	Sea water pressure at circulating pump outlet	●↓	●	—
<p>Symbols:</p> <ul style="list-style-type: none"> ● — remote indication (continuous); — remote indication (on call); ↑ — alarm for high value; ↓ — alarm for low value; ■ — automatic start of stand-by pumps; × <p>¹When re-heating is used, an additional alarm is required at turbine inlet.</p> <p>Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 2 parameters — a sensor for automatic start of stand-by pumps; for Group 3 parameters — a sensor of safety system (turbine shutdown).</p>				

Table 4.2.10-4

Main gas turbines

Nos	Monitored parameter	Group 1: indication, alarm	Group 2: automatic start of stand-by pumps with alarm	Group 3: automatic shutdown of gas turbine
1	Lubricating oil pressure at inlet	●↓	●	×
2	Lubricating oil temperature at inlet	●↑	—	—
3	Bearing temperature	●↑	—	—
4	Gas temperature at gas turbine outlet	●↑	—	×
5	Flame failure or ignition system failure or stratification of temperatures over flame tubes	●↑	—	×
6	Automatic start system	○	—	—
7	Fuel oil pressure at gas turbine inlet	●↓	—	×
8	Fuel oil pressure before burners	●↓	—	×
9	Fuel oil temperature before burners ²	●↑↓	—	—
10	Pressure differential across air cleaner	●↑	—	—
11	Gas turbine vibration at each support	●↑	—	×
12	Axial displacement of rotor	↑	—	×
13	Gas turbine speed (at each rotor)	●↑	—	×
14	Oil level in lubricating oil tank	●↓	—	—
15	Automatic gas turbine shutdown	○	—	—
16	Gas pollution of machinery room	●↑	—	×
17	Temperature under sheath	●↑	—	—
18	Gas temperature after gas turbine	●↑	—	—
19	Failure of power supply to control, alarm and safety systems	○	—	—
<p>Symbols:</p> <ul style="list-style-type: none"> ● — remote indication (continuous); — remote indication (on call); ↑ — alarm for high value; ↓ — alarm for low value; 				

Table 4.2.10-4 - continued

<p>● — automatic start of stand-by pumps; × — turbine shutdown. D — remote indication (on call);</p> <p>¹When gas is used. ²When high-viscosity fuels are used. ³Shutdown resulted from power turbine speed.</p> <p>Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 2 parameters — a sensor for automatic start of stand-by pumps; for Group 3 parameters — a sensor of safety system (turbine shutdown).</p>
--

Table 4.2.10-5

Shafting, CPP, reduction gear and couplings

Nos	Monitored parameter	Group 1: indication, automatic slowdown	Group 3: automatic shutdown of engine (turbine)
1	Shafting		
1.1	Temperature of thrust bearing (or lubricating oil), including those built in engine and reduction gear	↑▼	×
1.2	Temperature of shaft bearings (or lubricating oil)	↑	—
1.3	Temperature of sterntube bearing (or lubricating oil) ¹	↑	—
1.4	Lubricating oil level in sterntube lubricating tank ²	↓	—
1.5	Water flow at sterntube inlet ³	↓	—
2	CPP		
2.1	Hydraulic oil pressure at outlet of filter	↓	—
2.2	Hydraulic oil level in sterntube oil lubricating tank	↓	—
2.3	Loss of auxiliary power (power supply to controls) ⁴	○	—
3	Reduction gears and couplings		
3.1	Lubricating oil pressure at reduction gear inlet ⁵	●↓	×
3.2	Lubricating oil temperature in reduction gear	D↑▼	—
3.3	Temperature of each sliding bearing ⁶	↑	—
3.4	Hydraulic oil pressure at coupling inlet	●↓	—
<p>Symbols:</p> <p>● — remote indication (continuous); D — remote indication (on call); ↑ — alarm for high value; ↓ — alarm for low value; ▼ — slowdown; ○ — alarm signal; × — turbine shutdown.</p> <p>¹Refer to 5.6.3, Part VII "Machinery Installations". ²With closed sterntube. ³When water lubrication is used. ⁴Indication at navigation bridge. ⁵Where a coupling is fitted, disengagement of coupling may be effected instead of engine shutdown. ⁶For engines having power of more than 2250 kW.</p> <p>Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 3 parameters — a sensor of safety system (engine (turbine) shutdown).</p>			

4.3 AUTOMATED BOILER PLANTS

4.3.1 The requirements of the present Chapter cover boiler plants with oil-burning installations, waste-heat boilers and composite boilers, as well as combinations of such boilers forming part of the ship's machinery plants.

4.3.2 When two or more boilers fitted on board feed a common steam main, provision shall be made for automatic control of each boiler singly operating under load, where such operation is provided by the design, keeping the standby boilers in readiness and putting the boilers under load, parallel operation of boilers and securing all steam.

Automatic transfer from one operating mode to another shall not initiate operation of the safety valves,

alarms to indicate steam pressure and water level in boilers and in hot well (deaerator) of steam boiler plants, and in case of thermal fluid boilers, alarm to indicate the fluid temperature after the boilers and before the consumers, as well as the alarm to indicate the level in the expansion tank.

4.3.3 In waste-heat boilers the transfer of the evaporative mode to the water-heating mode and vice-versa shall not initiate operation of the safety valves, alarms to indicate steam pressure and water level in boilers and in hot well, as well as the necessity of the additional feed water.

4.3.4 Steam pressure and thermal fluid temperature shall be regulated automatically. Besides, the steam boilers shall be provided with automatic feed water regulators.

The waste-heat boilers may have no automatic steam pressure and thermal fluid temperature regulation, if alternative arrangements are provided to stabilize the said parameters.

4.3.5 Steam boilers shall have at least two low water level detectors independent of each other and connected to different output devices. The lower one shall be used solely for no-water protection.

The second detector may also be used for shutdown in case of low water levels, or for alarm and feed water regulating systems.

The above requirement does not apply to forced-circulation boilers, waste-heat boilers, the design of which allows operation without water, and to the secondary system headers of double-pressure boilers.

4.3.6 Provision shall be made for a remote shutdown of the burning boilers and closing of dampers in waste-heat boilers allowing no "dry" operation, from the control station where continuous watch is kept.

4.3.7 Automated oil-burning boilers shall be fitted up with interlocking devices to permit fuel oil being fed into the boiler furnace during firing-up, when the requirements listed below are complied with

in addition to those of 5.3.2, Part X "Boilers, Heat Exchangers and Pressure Vessels":

.1 fuel temperature (viscosity) is such that adequate atomisation is assured;

.2 pressure of steam or air for atomisation is within the normal range.

4.3.8 Automated oil-burning boilers shall be equipped with protective devices in accordance with the requirements of 5.3.3, Part X "Boilers, Heat Exchangers and Pressure Vessels".

4.3.9 Starting of boiler plants from cold condition and after being shut down by the protection system and if the ignition of oil fuel fails shall be possible from the local control station only.

4.3.10 Boiler plants shall be provided with alarms to indicate fire outbreak in the boiler flues. Position of detectors shall be chosen depending on the design features of boilers.

4.3.11 Monitored parameters of automated boiler plants, measuring points, limited parameter values and types of automatic protection and indication shall be found in Table 4.3.11.

Table 4.3.11

Automated boiler plants

Nos	Monitored parameter	Indication, alarm	Automatic protection
1	Main steam boilers and essential auxiliary steam boilers, waste-heat boilers and alternately fired boilers		
1.1	Steam pressure in boiler drum (at super-heater outlet) ¹	●↑↓	—
1.2	Steam temperature at super-heater outlet	●↑	—
1.3	Steam temperature at steam cooler outlet	●↑	—
1.4	Water level in boiler drum	↑ ² ↓	× ³
1.5	Feed water pressure or pressure differential ⁴	●↓	—
1.6	Stoppage of circulation in forced-circulation boilers	○	×
1.7	Water level in steam separator	↓	—
1.8	Water level in hot well	↓	—
2	Automatic oil-burning installations		
2.1	Fuel oil pressure at burner inlet ⁴	↓	—
2.2	Atomization air or steam pressure	↓	—
2.3	Fuel oil temperature at burner inlet ⁵	●↓	—
2.4	Air pressure before oil-burning installation ⁶	↓	×
2.5	Flame failure	○	×
3	Thermal liquid boilers and boiler plants		
3.1	Thermal liquid temperature at boiler outlet	↑	×
3.2	Thermal liquid flow at boiler outlet	↓	×
3.3	Thermal liquid level in expansion tank	↑↓	× ³ ■ ³
3.4	Thermal liquid leakage in the furnace of the auxiliary boiler	○	×■
3.5	Thermal liquid leakage in the drain chamber of the waste-heat boiler	○	×■
3.6	Increase of gas temperature in the flue duct of the auxiliary boiler	○	×■
3.7	Increase of gas temperature in the flue duct of the waste-heat boiler	○	×■
Symbols: ● — remote indication (continuous); ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; ■ — circulating pump shutdown; × — shutdown (stoppage of heat application).			
¹ For auxiliary boilers, alarm may be provided in the main steam line only. ² Only for boilers to power machinery. ³ Only after parameter reaches low value. ⁴ For main boilers only. ⁵ For heavy oil burning installations. ⁶ May be dispensed with, where the forced-draft fan and fuel oil pump are directly driven by a single prime mover.			

4.4 AUTOMATED ELECTRIC POWER PLANTS

4.4.1 Automated electric power plants shall ensure remote starting of generator sets with automatic synchronization, taking over and load sharing.

4.4.2 Besides compliance with the requirements of 3.1.3, Part XI "Electrical Equipment", in order to ensure continuous power supply on board ships where electrical power is normally supplied from one generator, control devices shall be provided to ensure automatic starting of standby generator, automatic synchronization, taking over and distribution of load in cases where:

maximum permissible load is reached by the generator during operation;

there is malfunction of the operating unit, which enables an automatic synchronization of generators to be carried out.

4.4.3 Indicators shall be provided at relevant control stations to warn that the generator sets are ready to start immediately (automatically).

4.4.4 Provision shall be made for preliminary determination of sequence, in which the generators shall be started automatically and connected to the busbars of the main switchboard.

4.4.5 If the shaft-generator rotational speed or inlet steam pressure of exhaust gas steam turbine-generator is lowered so that the working parameters as stated under 2.11.3, Part IX "Machinery", as well as 10.6.2 and 10.7.2, Part XI "Electrical Equipment" cannot be achieved, at least one independently driven generator shall be automatically started to ensure compliance with provision of 4.4.2.

4.4.6 Monitored parameters of automatic electric power plants (except emergency), measuring points, limiting values of parameters and types of automatic protection and parameter indication shall be found in Tables 4.4.6-1 to 4.4.6-3.

Table 4.4.6-1

Automated ship electric power plants

Nos	Monitored parameter	Indication, alarm	Automatic protection
1	Ship mains		
1.1	Voltage	●↓	×
1.2	Current frequency	●↓	—
1.3	Insulation resistance	↓	—
2	Generators		
2.1	Load (current)	●↑	▼×
2.2	Reverse power (current)	↑	×
2.3	Winding temperature ¹	↑	—
Symbols: ● — remote indication; ↑ — alarm for high value; ↓ — alarm for low value; ▼ — disconnection of non-essential consumers; × — disconnection of generator. Effected by the protection system of the generators (refer to 8.2, Part XI "Electrical Equipment").			
¹ Required only for a.c. generators having output of more than 5000 kW or axial length of active steel more than 1000 mm.			

Table 4.4.6-2

Internal combustion trunk piston engines for driving generators

Nos	Monitored parameter	Alarm	Automatic shutdown of engine with alarm
1	Fuel oil leakage from high-pressure piping	○	—
2	Lubricating oil temperature	↑	—
3	Lubricating oil pressure	↓	×
4	Oil mist concentration in crankcase ¹	↑	×
5	Cooling water pressure or flow	↓	—
6	Cooling water or air temperature	↓	—
7	Cooling water level in expansion tank ²	↓	—
8	Fuel oil level in daily tank	↓	—
9	Starting air pressure	↓	—
10	Overspeed	—	×
11	Fuel oil viscosity (temperature) at inlet of high-pressure pumps ³	↑(L)	—
12	Exhaust gas temperature at each cylinder outlet ⁴	↑	—
13	Gas concentration in machinery spaces ⁵	↑	—
14	Common rail fuel oil pressure	Min	—
15	Common rail servo oil pressure	Min	—
Symbols: ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; × — engine shutdown.			
¹ For engines having power of more than 2250 kW or a cylinder bore more than 300 mm. ² If separate cooling system provided. ³ When working on heavy fuel. ⁴ For engines with cylinder output more than 500 kW. ⁵ Required where installations with dual-fuel (gas — liquid fuel) engines are used.			

Table 4.4.6-3

Steam turbines driving generators

Nos	Monitored parameter	Indication, alarm	Automatic shutdown of turbine
1	Lubricating oil pressure at oil cooler outlet	●↓	×
2	Lubricating oil temperature at bearing outlets	●↑	—
3	Steam pressure in condenser	●↑	×
4	Steam pressure before turbine	●↓	—
5	Water level in condenser	↑	—
Symbols: ● — remote indication (on call); ↑ — alarm for high value; ↓ — alarm for low value; × — turbine shutdown.			

4.5 AUTOMATED COMPRESSOR PLANTS

4.5.1 Compressed air systems shall be fitted up with ar-rangements for automatic removal (blow out) of water and oil.

4.5.2 The automated compressor plants shall be capable of operating manually from the local and remote control stations and automatically.

In automatic mode of operation, the compressors shall keep up nominal pressure of compressed air in the air receivers so that:

.1 when the air pressure drops to the preset value, for example, to 90 per cent, the preselected compressor shall be automatically started and automatically shut down once the air pressure have reached a value equal to the nominal one;

.2 in case of an intensive air consumption and further drop of air pressure, for example, to 80 per cent, a second compressor turned on automatic mode shall be automatically started, and both compressors shall keep operating until the nominal pressure is attained.

Other operation logic of the automated compressors is subject to the special consideration of the Register.

4.5.3 Monitored parameters of automated compressor plants, measuring points, limiting values of parameters and types of automatic protection and indication shall be found in Table 4.5.3.

4.6 AUTOMATED PUMPING UNITS

4.6.1 Automated pump control system shall ensure automatic starting of standby pumps and change-over as necessary in plants in case of pump failure or upon reaching the highest permissible deviations of parameters in essential plants. The faulty pump shall be stopped and an alarm given only after the standby pump has been started.

4.6.2 The electric circuit of pumps having equal output shall make it possible to use each of them as the main pump.

This requirement does not apply to attached pumps.

4.7 AUTOMATED BILGE PUMPING OF MACHINERY SPACES

4.7.1 Depending on the water level in the bilge wells, the bilge wells in machinery spaces shall be drained either automatically or remotely. Indication for pump operation shall be provided.

4.7.2 If, after the bilge pumps have been started, they do not come to stop within a specified period of time, that is, the water in the bilge wells does not fall, an alarm shall be given.

Table 4.5.3

Automated compressor plants

Nos	Monitored parameter	Indication, alarm	Automatic protection
1	Lubricating oil pressure at compressor inlet	↓	×
2	Coolant flow at compressor outlet ¹	↓	×
3	Air temperature at cooler outlet	↑	—
4	Starting air pressure at air receiver outlet	●↓	—
5	Control air pressure	↓	—
Symbols: ● — remote indication; ↑ — alarm for high value; ↓ — alarm for low value; × — compressor shutdown.			
¹ Instead of flow, maximum coolant temperature may be monitored.			

4.7.3 A separate sensor shall be provided to signal the highest permissible level, which would be independent of the sensors fitted to control the bilge pumps.

4.7.4 Monitored parameters of automated bilge plants, measuring points and limiting values of parameters shall be found in Table 4.7.4.

Table 4.7.4
Automated bilge plants of machinery spaces

Nos	Monitored parameter	Alarm
1	Water level in bilge wells	↑ ¹
2	Emergency water level in bilge wells and shaft passages ²	↑
Symbols: ↑ — alarm for high value; ↓ — alarm for low value.		
¹ When remotely controlled. ² Alarm signal is brought out to the wheelhouse.		

4.8 AUTOMATED REFRIGERATING PLANTS

4.8.1 In accordance with 1.1, Part XII "Refrigerating Plants", automated refrigerating plants shall comply with the requirements of 7.2 of the same Part, as well as to provide automatic maintenance of temperature in the refrigerated spaces.

4.8.2 Provision shall be made for indication of the automated refrigerating plant operation and for alarm of its malfunction.

4.8.3 Monitored parameters of automated refrigerating plants, measuring points, limiting values of parameters and types of protection shall be found in Table 4.8.3.

Table 4.8.3
Automated refrigerating plants

Nos	Monitored parameter	Alarm	Automatic protection
1	Driving motors		
1.1	Motor load (current)	↑	▼
2	Compressors		
2.1	Suction pressure	↓	×
2.2	Discharge pressure ¹	↑	×
2.3	Discharge temperature	↑	×
2.4	Lubricating oil pressure or flow	↑	×
2.5	Lubricating oil temperature	↑	×
2.6	Rotor displacement ²	↑	×
2.7	Bearing temperature ²	↑	×
3	Pressure vessels, heat exchangers, refrigerant, secondary refrigerant, cooling water pumps		
3.1	Refrigerant flow in pump	↓	□ ³
3.2	Secondary refrigerant flow in evaporator	↓	×
3.3	Cooling water discharge pressure or flow in discharge pipeline	↓	×
3.4	Refrigerant level in circulation receivers, liquid separators, intermediate vessels, level type evaporators ⁴	↑	×
3.5	Secondary refrigerant temperature at evaporator outlet	↓	× ³
3.6	Secondary refrigerant level in expansion tank	↑↓	—
4	Spaces with controlled atmosphere, atmosphere control arrangements		
4.1	Air temperature in refrigerated cargo spaces	↑↓	—
4.2	Stopping of air cooler ventilator for refrigerated cargo space ⁵	○	—
4.3	Refrigerant concentration in air of spaces with equipment under refrigerant pressure ⁶	↑	■
4.4	CO ₂ , O ₂ , N ₂ concentration in refrigerated cargo spaces ⁷	↑↓	—
4.5	Relative air humidity in refrigerated cargo spaces ⁷	↑↓	—
Symbols: ● — remote indication; ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; ▼ — engine shutdown; □ — pump stop; ■ — switching-on of emergency ventilation, except emergency ventilation of refrigerated cargo spaces, for switching-on of which it is necessary previously to render the air duct shut-off devices operative; × — compressor shutdown.			
¹ in case of piston two-stage compressors, for each stage. ² For centrifugal compressors. ³ Or stopping the delivery of refrigerant into evaporator. ⁴ Compressor shutdown when the level is maximum. In case of liquid separators performing only protective functions, the refrigerant level indication may be dispensed with. ⁵ For each ventilator. ⁶ Separate alarm on the navigation bridge. ⁷ Where applicable: for systems with atmosphere control, for carriage of fruits and vegetables.			

4.9 EQUIPMENT ARRANGEMENT ON THE BRIDGE

4.9.1 Provision shall be made for a control station to effect-automated remote control of main machinery and/or propellers in conformity with 3.2, Part VII "Machinery Installations".

4.9.2 An alarm device shall be fitted to give group or individual signals of malfunctions of machinery installation, including those that require immediate shutdown of the main machinery and those that require reduction of the main machinery power. In this case a system of alarms included in common alarm shall be provided separately at main control stations or, alternatively, at local control stations.

In the latter case, a master alarm display shall be provided at the main control station showing which of the local control stations is indicating a fault condition.

4.9.3 On the bridge, provision shall be made for the following separate alarms:

"water in machinery space";

"fire in machinery space";

"alarm system failure";

as well as separate alarm "high gas concentration in machinery space", if the ship is provided with main and/or auxiliary dual-fuel (gas — liquid fuel) engines.

4.9.4 Provision shall be made for visual signalling (indication) in case of signals required by 4.9.2 and 4.9.3 being acknowledged in the machinery space.

4.9.5 Provision shall be made for remote control bilge system wells of machinery spaces, where no provision is made for an automated bilge system in compliance with 4.7.1.

4.10 EQUIPMENT ARRANGEMENT IN MACHINERY SPACES

4.10.1 Provision shall be made in the vicinity of the local control station for alarms and indicators of parameters as required by 4.2 to 4.8.

4.10.2 The controls of auxiliaries (pumps, separators, boiler plants, generator prime movers) are recommended to be installed in close proximity to the local control station of the main machinery.

4.10.3 Main machinery control room, if provided, shall be fitted up with the following:

.1 devices required by 3.2, Part VII "Machinery Installations";

.2 alarm panel;

.3 devices to indicate the operating modes of machinery and plants;

.4 disconnecting devices of the oil-burning installations of boilers, incinerators, ventilators of machinery spaces, separators fuel oil and lubricating oil pumps.

.5 remote controls of bilge wells for drainage in machinery spaces, where no provision is made for an automated bilge system in compliance with 4.7.1.

4.10.4 If agreed with the Register, the engine control room may be located outside the machinery space and the list of its equipment specified in 4.10.3 may be changed.

4.10.5 Where there is an enclosed main machinery control room, a device shall be fitted therein to call personnel from the machinery spaces.

4.10.6 At the main machinery control room, the following separate signals shall be provided:

"water in machinery space";

"fire in machinery space";

as well as separate alarm "limiting gas concentration level in machinery space", if the ship is provided with main and/or auxiliary dual-fuel (gas — liquid fuel) engines.

4.11 DEVICES IN ENGINEERS' ACCOMMODATION

4.11.1 In engineers' cabins, public spaces, as well as in spaces where watch is kept while in port, group alarm devices shall be fitted to warn of the malfunctions of machinery and plants, as well as signal devices in accordance with 4.9.3.

The acknowledgement of each signal from these devices shall cancel the audible signal only.

4.11.2 Where there are several cabins a switch for the devices mentioned in 4.11.1 may be provided to select the responsibility (watch keeper). The remaining cabin devices are disconnected in this case.

5 SHIPS WITH AUT2 IN CLASS NOTATION

5.1 GENERAL

5.1.1 Ships and floating facilities with the automation mark **AUT2** in class notation shall be equipped with machinery plant automation systems to the extent sufficient to ensure the manoeuvrability and safety of self-propelled ships or the safety of non-self-propelled ships under all operating conditions without permanent attendance of personnel in machinery spaces, but if watch is kept at the main machinery control room.

5.1.2 Unless otherwise provided hereafter, the requirements of Section 4, except for 4.11, shall be complied with.

5.1.3 Provision shall be made for automation of main machinery and propellers in accordance with the applicable requirements of 4.2.

5.1.4 An alarm system shall be provided for all applicable parameters and working conditions mentioned in Section 4.

5.1.5 All the equipment installed in the machinery space shall be adapted to unattended service. On agreement with the Register, certain operations (replenishment of tanks, cleaning of strainers, etc) may be performed manually if undertaken not more than once every 12 hours.

5.2 EQUIPMENT ARRANGEMENT ON THE BRIDGE

5.2.1 Provision shall be made for remote automated control of the main machinery and/or propellers from the navigation bridge, in which case:

.1 equipment as required by 3.2, Part VII "Machinery Installations" shall be fitted;

.2 provision shall be made for alarm, which would enable to identify the reason of failure that requires slowdown and/or shutdown of the main machinery.

5.3 EQUIPMENT ARRANGEMENT IN MACHINERY SPACES

5.3.1 Provision shall be made for an enclosed main machinery control room fitted out in conformity with 4.10.3 and, additionally, with remote controls of essential auxiliaries if the latter are not automated.

5.3.2 Provision shall be made for the call and signal devices as stipulated by 4.10.5 and 4.10.6.

5.4 ELECTRIC POWER PLANTS

5.4.1 Besides compliance with the requirements of 3.1.3, Part XI "Electrical Equipment", where no provision is made for an automated electric power plant in conformity with 4.4, the following shall be available:

remote start and shutdown of generator prime movers from the main machinery control room;

remote synchronizing, switching on and load sharing from the main machinery control room. These operations may be effected from the main switchboard if installed at the main machinery control room.

5.5 BILGE SYSTEMS OF MACHINERY SPACES

5.5.1 Where no provision is made for an automated bilge system in conformity with 4.7, bilge wells in machinery spaces shall be remotely drained from the main machinery control room.

5.5.2 Alarm shall be provided in conformity with 4.7.4.

6 SHIPS WITH AUT3 IN CLASS NOTATION

6.1 GENERAL

6.1.1 Ships and floating structures with the automation mark **AUT3** in class notation, the main machinery of which have the power up to 2250 kW, shall be fitted with machinery installation automation systems to the extent, by which their manoeuvrability and safety would be ensured without permanent attendance of machinery spaces and main machinery control room (as far as non-self-propelled

ships are concerned, the above power is the power of the prime movers of generators, which ensure that the main purpose of the ship is fulfilled).

6.1.2 Unless otherwise provided hereafter, the requirements of Section 4 shall be complied with.

6.1.3 Monitored parameters of machinery and plants, measuring points, limiting values of parameters and types of automatic protection and parameter indication shall be found in Table 6.1.3.

Table 6.1.3

Nos	Monitored parameter	Group 1: indication, alarm, automatic slowdown	Group 2: automatic start of stand-by pumps with alarm ¹	Group 3: automatic shutdown of engine
1	Main internal combustion engines			
1.1	Lubricating oil pressure at engine inlet	●↓	●	×
1.2	Lubricating oil temperature at engine inlet	●↑	—	—
1.3	Lubricating oil flow at lubricator outlet	↓▽ ²	—	—
1.4	Lubricating oil pressure differential across filter	●↑	—	—
1.5	Turbocharger lubricating oil pressure at bearing inlet ³	↓	—	—
1.6	Oil mist concentration or bearing temperature at each crank or bearing	↑▽ ^{2, 4}	—	× ⁵
1.7	Coolant pressure or flow at engine inlet	●↓▽ ²	●	—
1.8	Coolant temperature at engine outlet	●↑▽ ²	—	—
1.9	Cooling sea water pressure or flow	●↓	●	—
1.10	Exhaust gas temperature in main line	↑	—	—
1.11	Exhaust gas temperature at each cylinder outlet ⁶	●↑▽ ²	—	—
1.12	Exhaust gas temperature. Deviation from mean value by cylinders ⁶	↑	—	—
1.13	Starting air pressure before starting valve	●↓	—	—
1.14	Air pressure in engine control system	↓	—	—
1.15	Scavenging air temperature at scavenging air cooler outlet	↑	—	—
1.16	Fuel oil pressure at high-pressure pump inlets	●↓	●	—
1.17	Fuel oil viscosity (temperature) at engine inlet ⁷	↑(↓)	—	—
1.18	Fuel oil level in daily service tank	↓	—	—
1.19	Fuel oil leakage from high-pressure piping	○	—	—
1.20	Engine speed	●↑	—	×
1.21	Power supply for control, alarm and protection system	○	—	—
1.22	Gas concentration in machinery spaces ⁸	↑	—	—
2	Boilers of machinery installation⁹			
3	Internal combustion engines used as generator drives			
3.1	Lubricating oil pressure at engine inlet	↓	—	×
3.2	Coolant pressure or flow at engine inlet	↓	—	—
3.3	Coolant temperature at engine outlet	↑	—	—
3.4	Fuel oil leakage from high-pressure piping	○	—	—
3.5	Engine speed	●↑	—	×
3.6	Starting air pressure (before starting valve)	↓	—	—
4	Reduction gear			
4.1	Lubricating oil pressure at reduction gear inlet	↓	—	×
4.2	Lubricating oil temperature in reduction gear	↑	—	—
5	Starting air compressors			
5.1	Lubricating oil pressure at compressor inlet	↓□	—	—
5.2	Air temperature at compressor outlet	↑	—	—
6	Tanks			
6.1	Lubricating oil level in daily service tanks	↓	—	—
6.2	Oil leakage level in oil leakage tank	↑	—	—
6.3	Fuel oil level in daily service tank	↓	—	—
6.4	Fuel oil level in overflow tank	↑	—	—
6.5	Coolant level in expansion tank	↓	—	—
7	Ship mains			
7.1	Voltage	●↑↓	—	—

Table 6.1.3 — continued

Nos	Monitored parameter	Group 1: indication, alarm, automatic slowdown	Group 2: automatic start of stand-by pumps with alarm ¹	Group 3: automatic shutdown of engine
7.2	Load (current)	●↑	—	—
7.3	Current frequency	●↓	—	—
7.4	Insulation resistance	↓	—	—
<p>Symbols:</p> <ul style="list-style-type: none"> ● — remote indication (continuous); ◐ — remote indication (on call); ↑ — alarm for high value; ↓ — alarm for low value; ○ — alarm signal; ■ — automatic start of stand-by pumps; □ — compressor shutdown; ▼ — slowdown; × — engine shutdown. <p>¹When independent stand-by pumps are available. ²On agreement with the Register, special visual and audible alarm may be provided instead of slowdown where the internal combustion engines are concerned. ³When an independent lubrication pump is available. ⁴For low-speed engines with cylinder bore over 300 mm. ⁵For medium- and high-speed engines with cylinder bore over 300 mm. ⁶For engines with cylinder output above 500 kW. ⁷When working on heavy fuel. ⁸Required, where installations with dual-fuel (gas — liquid fuel) engines are used. ⁹Refer to Table 4.3.11.</p> <p>Note. For Group 1 parameters a common sensor is provided for indication, alarm and safety systems (for slowdown); for Group 2 parameters — a sensor for automatic start of stand-by pumps; for Group 3 parameters — a sensor of safety system (engine shutdown).</p>				

6.2 EQUIPMENT ARRANGEMENT ON THE BRIDGE

6.2.1 Provision shall be made for a remote control station for main machinery and/or propellers in conformity with 3.2, Part VII "Machinery Installations".

6.2.2 As far as applicable, provision shall be made for remote control of essential auxiliaries.

6.2.3 Provision shall be made for shutting down the oil burning installations of automated boiler plants, incinerators, machinery space fans, fuel oil pumps, if any.

6.2.4 An alarm device shall be fitted to indicate malfunction of the machinery installation in accordance with 4.9.2.

6.2.5 On the bridge, provision shall be made for the following separate alarms:

"water in machinery space";

"fire in machinery space";

"alarm system failure";

as well as separate alarm "high gas concentration in machinery space", if the ship is provided with main and/or auxiliary dual-fuel (gas — liquid fuel) engines.

6.2.6 Visual alarm shall be provided to indicate acknowledgement of alarms in machinery space as required in 6.2.4 and 6.2.5.

6.2.7 Provision shall be made for remote drainage of bilge wells in machinery spaces. The requirements of 4.7.2 to 4.7.4 shall be complied with.

6.3 EQUIPMENT ARRANGEMENT IN MACHINERY SPACES

6.3.1 In the vicinity of the main machinery local control station alarms and indicators of parameters, as stipulated by Table 6.1.3, shall be provided.

6.3.2 As far as applicable, the controls of auxiliaries shall be located in conformity with 4.10.2.

6.3.3 Where provision is made for an enclosed main machinery control room, the applicable requirements of 4.10.3 to 4.10.6 shall be complied with.

6.4 DEVICES IN ENGINEERS' ACCOMMODATION

6.4.1 As far as applicable, the requirements of 4.11 shall be complied with.

7 COMPUTERS AND COMPUTER-BASED SYSTEMS

7.1 APPLICATION

7.1.1 The requirements of the present Section apply to computers and computer-based systems used for monitoring and control of essential machinery and arrangements, which ensure in combination with other automation systems (requirements thereto are set forth in Sections 2 to 6) the operation of the machinery installation with unattended machinery spaces.

Ships fitted with such automation systems may be assigned, in accordance with 2.2.6, Part I "Classification", one of the following distinguishing automation marks in the class notation:

.1 AUT1-C, AUT2-C or AUT3-C — where automation of the machinery installation is based on computers or programmable logic controllers;

.2 AUT1-ICS, AUT2-ICS or AUT3-ICS — where computer-based systems are combined into a network forming a common integrated system.

7.1.2 The present requirements apply also to computers and computer-based systems used for control of non-essential machinery and devices where loss of control results in serious damage to the ship or its machinery, e.g. explosion of domestic water boilers.

7.2 DEFINITIONS AND EXPLANATIONS

7.2.1 Integrated system is a combination of computer-based systems, which are interconnected, in order to allow centralized access to sensors information and/or command/control.

Interface is a transfer point, at which information is exchanged. Examples of interface include: input/output interface used for interconnection with sensors and actuators; man-machine interface, e.g. monitors, keyboards, tracker-balls, etc. used for communication between the operator and the computer; communications interface used to enable serial communications/networking with other computers or peripherals.

Computer is a programmable electronic device for storing and processing data in the digital form, making calculations or performing control. A computer may be monoblock or may consist of several interconnected units.

Computer-based system is a system of one or more computers, associated software, peripherals and interfaces.

Programmable logic controller (PLC) is a computer device designed as a stand-

alone functional unit and intended to perform functions relevant to control and monitoring of ship's machinery and processes.

Monitor is an electronic device for representing data.

Peripheral is a device performing an auxiliary action in the system, e.g. printer, data storage device, etc.

Software is programs, data and documentation associated with the operation of a computer-based system.

Node is a point of interconnection to a data communication link.

7.3 GENERAL REQUIREMENTS FOR THE DESIGN OF COMPUTER SYSTEMS USED FOR CONTROL AND MONITORING

7.3.1 Computer-based systems shall fulfil the functional requirements of the system under control for all operating conditions including emergency conditions, taking into account:

- danger to persons;
- environmental impact;
- damage to equipment;
- usability;
- operability of non-computer devices and systems.

7.3.2 If process times for functions of the system are shorter than the reaction times of the operator and therefore damage cannot be prevented by manual intervention, means of automatic intervention shall be provided.

7.3.3 A computer-based system shall have sufficient capability to:

- perform necessary autonomous operations;
- accept operator (user) commands;
- inform the operator (user) correctly under all operating conditions including emergency.

7.3.4 System capability shall provide adequate response times for all functions, taking into consideration the maximum load and maximum number of simultaneous tasks, including network communication speed, under normal and abnormal process conditions.

7.3.5 Computer-based systems shall be designed in such a way that they can be used without special previous knowledge, otherwise appropriate assistance shall be provided for the user.

7.3.6 Computer-based systems shall be protected against unintentional or unauthorized modification of programs and data.

7.4 HARDWARE REQUIREMENTS

7.4.1 Hardware shall function reliably in conditions normally encountered in ships as specified in 2.1.

7.4.2 The design of the hardware shall ensure easy access to interchangeable parts for repairs and maintenance.

7.4.3 Each replaceable part shall be simple to replace and shall be constructed for easy and safe handling. All replaceable parts shall be arranged in such a way that it is not possible to connect them incorrectly or to use incorrect replacements. Where this is not practicable, the replaceable parts shall be clearly marked.

7.5 SOFTWARE REQUIREMENTS

7.5.1 Systematic monitoring procedures shall be followed during all phases of the software life cycle (development, installation and subsequent modification).

7.5.2 System tests shall be specified, performed and documented. These tests shall include all software functions and important combinations of functions, performance, dependability and usability requirements under all modes of operation including emergency conditions and behaviour under failure conditions.

7.5.3 Any modifications of program contents and data shall be made in conformity with relevant standards and documented.

7.5.4 The software for monitoring, control and alarm computer-based systems shall not be permanently lost or altered due to short-term drops of supply voltage or due to network frequency and voltage fluctuations.

Provisions shall be made for structural means preventing the unintentional or unauthorized intervention, which may result in the alteration of control programs or limiting values of computer-based system parameters under control.

7.6 SYSTEM CONFIGURATION REQUIREMENTS

7.6.1 General.

7.6.1.1 The hardware and software shall be of modular, hierarchical design in order to maximize the fault tolerance of the system.

7.6.1.2 The selection of the computer equipment shall be consistent with safe operation of the system under control.

7.6.2 Self-test.

Computer-based systems shall have self-test capability to monitor for correct operation and alarm shall be given for an abnormal condition.

7.6.3 Power supply.

7.6.3.1 The sources of power supply shall be monitored for failure and shall give an alarm in the event of abnormal condition.

7.6.3.2 Program and data held in the system shall be protected from corruption by loss of power.

7.6.3.3 Redundant systems shall be selectively fed and separately protected against short circuits and overloads.

7.6.4 Installation.

7.6.4.1 Equipment and its associated cabling shall be installed in such a way as to minimize electromagnetic interference between the equipment concerned and other equipment on board.

7.6.4.2 Cables used for data communication shall be of adequate mechanical strength, suitably supported and also protected from mechanical damage.

7.6.5 Data communication links.

7.6.5.1 The data communication link shall be continuously self-checking, for detecting failures on the link itself and data communication failure on nodes and shall give an alarm in the event of abnormal condition.

7.6.5.2 When the same data communication link is used for two or more essential functions, this link shall be redundant. Redundant data communication links shall be routed with as much separation as practical.

7.6.5.3 Switching between redundant links shall not disturb data communication or continuous operation of functions. An automatic switching alarm signal shall be transmitted.

7.6.5.4 To ensure that data can be exchanged between various systems, standardized interfaces shall be used.

7.6.6 Fail-to-safe principle.

7.6.6.1 In the event of a failure of a computer-based system, systems under control shall automatically revert to the least hazardous condition.

7.6.6.2 The failure and restarting of computer-based systems shall not cause processes to enter undefined or critical states.

7.6.6.3 Control, alarm and safety functions shall be arranged such that a single failure will not affect more than one of these functions.

7.6.7 Integration of systems.

7.6.7.1 Operation with an integrated system shall be at least as effective as it would be with individual, stand-alone equipment. Where multifunction displays and controls are used they shall be duplicated and interchangeable.

7.6.7.2 Failure of one part (individual module, equipment or subsystem) of the integrated system

shall not affect the functionality of other parts, except for those functions directly dependent upon information from the defective part.

7.6.7.3 A complete failure in connectivity between parts shall not affect their independent functionality.

7.6.7.4 An alternative means of operation, independent of the integration, shall be available for all essential functions.

7.6.7.5 When systems under control are required to be duplicated and in separate compartments this shall be also applied to computer-based systems used for control and monitoring.

7.7 USER INTERFACE

7.7.1 General.

7.7.1.1 Computer-based systems shall be designed for ease of handling and user-friendliness and shall follow ergonomic principles.

7.7.1.2 The operational status of a computer-based system (on, off, non-failed, failed, etc) shall be easily recognizable.

7.7.1.3 A user guide shall be provided. The user guide shall describe for example:

- function keys;
- menu displays;
- computer-guided dialogue steps, etc.

7.7.1.4 An alarm shall be displayed at relevant operator stations for failure or shutdown of a subsystem.

7.7.2 Input devices.

7.7.2.1 Input devices shall have clearly definable functions, be reliable in use and operate safely under all conditions. The acknowledgement of the instruction given shall be recognizable.

7.7.2.2 Dedicated function keys shall be provided for frequently recurring commands and for commands, which shall be available for rapid execution. If multiple functions are assigned to keys, it shall be possible to recognize, which of the assigned functions is active.

7.7.2.3 Control panels on the bridge shall be provided with separate lighting. The level of lighting and the brightness of visual display units shall be controllable.

7.7.2.4 Where equipment operations or functions may be changed via keyboards access to such operations shall be provided for authorized personnel only.

7.7.2.5 If operation of a key is able to cause dangerous operating conditions, measures shall be taken to prevent the instruction in question from being executed by a single action such as:

- use of a special key lock;
- use of two or more keys.

7.7.2.6 Conflicting control interventions shall be prevented by means of interlocks or warnings. The active control status shall be recognizable.

7.7.2.7 The operation of input devices shall be logical and correspond to the direction of action of the controlled equipment.

7.7.3 Output devices.

7.7.3.1 The size, colour and density of text and graphic information displayed on a visual display unit shall be such that it may be easily read from the normal operator position under all operational lighting conditions. The brightness and contrast shall be capable of being adjusted to the prevailing ambient conditions in order to enable the information to be normally recognized.

7.7.3.2 Information shall be displayed in a logical priority.

7.7.3.3 If alarm messages are displayed on colour monitors, the distinctions in the alarm status shall be ensured even in the event of failure of a primary colour.

7.7.4 Graphical user interface.

7.7.4.1 Information shall be presented clearly and intelligibly according to its functional significance and association. Screen contents shall be logically structured and their representation shall be restricted to the data, which is directly relevant for the operator.

7.7.4.2 When using general purpose graphical user interfaces, only the functions necessary for the respective process shall be available.

7.7.4.3 Alarms shall be visually and audibly presented with priority over other information in every operating mode of the system; they shall be clearly distinguishable from other information.

7.7.4.4 All display and control functions in control stations operated by the same operators shall adopt a consistent user interface. Particular attention shall be paid to symbols, colours, controls, information priorities and layout.

7.8 TRAINING

7.8.1 Training shall be provided at a level required to effectively operate and maintain the system and shall cover normal, abnormal and emergency conditions. The user interface for training shall correspond with the real system.

7.8.2 Documentation shall be provided to support the training and shall be available for repeated use on board during maintenance of the computer systems.

7.8.3 Where a training mode is incorporated in a computer-based system it shall be clearly indicated when the training mode is active.

7.8.4 Whilst in the training mode the operation of the system shall not be impaired, and neither are any system alarms or indications to be inhibited.

7.9 TESTING

7.9.1 The computer-based systems shall be designed, manufactured and tested in accordance with the requirements of the Section and other requirements of the Rules. In the case of any integrated systems, evidence shall be furnished by a party responsible for the integration that the requirements applied to the integration of the subsystems have been fully satisfied.

7.9.2 In addition to the requirements of the Section, manufacturers shall ensure by means of quality control system that their products meet with their specifications.

7.9.3 Tests and inspections of a computer-based system shall be carried out with the aim of establishing the correct operation and the quality of a product.

7.9.4 Modifications of program contents and data, as well as change of version, shall be checked and tested.

7.10 PROGRAMMABLE ELECTRONIC SYSTEMS

7.10.1 Scope.

These requirements apply to the use of programmable electronic systems which provide control, alarm, monitoring or safety functions in addition to the requirements set forth in the present Section.

Navigational equipment and ship loading instruments are excluded.

7.10.2 General.

7.10.2.1 Programmable electronic systems are to fulfill the requirements of the system under control for all operating conditions, taking into account danger to persons, environmental impact, damage to ship as well as equipment, usability of programmable electronic systems and operability of non computer devices and systems, etc.

7.10.2.2 When an alternative design or arrangements deviating from these requirements are proposed, an engineering analysis carried out in accordance with a relevant international or national standard shall be submitted to the Register.

7.10.2.3 The use of unconventional technology for category III systems shall only be permitted in exceptional cases and is subject to special consideration by the Register.

7.10.3 System categories.

7.10.3.1 Programmable electronic systems shall be assigned into three system categories as shown in Table 7.10.3.1 according to the potential (possible) extent of the damage caused by a single failure within the programmable control and monitoring electronic systems.

Notes: 1. Consideration shall be given to the extent of the damage directly caused by a failure, but not to any consequential damage.

2. Identical redundancy will not be taken into account for the assignment of a system category.

Table 7.10.3.1

System categories		
Category	Effects	System functionality
I	Those systems, failure of which will not lead to dangerous situations for human safety, safety of the ship and/or threat to the environment	Monitoring function for informational/administrative tasks
II	Those systems, failure of which could eventually lead to dangerous situations for human safety, safety of the ship and/or threat to the environment	Alarm and monitoring functions; control functions which are necessary to maintain the ship in its normal operational and habitable conditions
III	Those systems, failure of which could immediately lead to dangerous situations for human safety, safety of the ship and/or threat to the environment	Control functions for maintaining the ship's propulsion and steering; safety functions

7.10.3.2 The assignment of a programmable electronic system to the appropriate system category shall be made according to the greatest likely extent of direct damage to machinery and equipment. In the systems where independent effective backup or other means of averting danger are provided, the system category III may be decreased by one category. Examples are given in Table 7.10.3.2.

The examples listed are not exhaustive.

Table 7.10.3.2

Examples of assignment to system categories	
System category	Examples
I	Maintenance support systems Information and diagnostic systems
II	Warning, alarm and monitoring equipment Tank capacity measuring equipment Control systems for auxiliary machinery Main propulsion remote control systems Fire detection systems Fire extinguishing systems Bulge systems Governors
III	Machinery protection systems/equipment Burner control systems Electronic fuel injection systems for diesel engines Control systems for propulsion and steering Synchronising units for main switchboards

7.10.4 Data communication links.

7.10.4.1 These requirements apply to system categories II and III using shared data communication links (local network) to transfer data between programmable electronic systems and equipment.

7.10.4.2 Where a single component failure results in loss of data communication means shall be provided to automatically restore data communication.

7.10.4.3 Loss of a data communication link shall not affect the ability to operate essential services by alternative means.

7.10.4.4 Means shall be provided to ensure the integrity of data and provide timely recovery of corrupted or invalid data.

7.10.4.5 The data communication link shall be self-checking, detecting failures on the link itself and data communication failures on nodes connected to the link. Detected failures shall initiate an alarm.

7.10.4.6 System self-checking capabilities shall be arranged to initiate transition to the least hazardous state for the complete installation in the event of data communication failure.

7.10.4.7 The characteristics of the data communication link shall be such as to transmit all necessary information in adequate time and to prevent overloading.

7.10.5 Additional requirements for wireless data communication links.

7.10.5.1 These requirements are in addition to the requirements of 7.10.4.2 to 7.10.4.7 and apply to system category II using wireless data communication links. For system category III, the use of wireless data communication links is subject to special consideration by the Register, taking into account 7.10.2.2.

7.10.5.2 Functions that are required to operate continuously to provide essential services dependant on wireless data communication links shall have an alternative means of control that can be brought in action within an acceptable period of time.

7.10.5.3 Wireless data communication shall employ recognized international wireless communication system protocols that incorporate the following:

.1 message integrity. Fault prevention, detection, diagnosis, and correction so that the received message is not corrupted or altered when compared to the transmitted message;

.2 configuration and device authentication. Shall only permit connection of devices that are included in the system design;

.3 message encryption. Protection of the confidentiality and or criticality the data content;

.4 security management. Protection of network assets, prevention of unauthorised access to network assets.

7.10.5.4 The wireless system shall comply with the radio frequency and power level requirements of

International Telecommunications Union and flag state requirements.

Consideration shall be given to system operation in the event of port state and local regulations that pertain to the use of radio-frequency transmission prohibiting the operation of a wireless data communication link due to frequency and power level restrictions.

7.10.6 Protection against modifications.

7.10.6.1 Programmable electronic systems of category I and II shall be protected against program modification by the unauthorized personnel (user).

7.10.6.2 For systems of category III modifications of parameters by the manufacturer shall be approved by the Register.

7.10.6.3 Any modifications in software or hardware made after performance of the tests witnessed by the Register as per item 6 of Table 7.10.8 shall be documented and submitted to the Register for approval.

7.10.7 Technical documentation.

7.10.7.1 For approval of programmable electronic systems of category II and III documentation in compliance with 1.4 shall be submitted.

When alternative design or arrangement is intended to be used, an engineering analysis carried out in accordance with a relevant international or national standard shall be submitted in addition (refer to 7.10.2.2).

7.10.7.2 For all tests required in accordance with the system category a test plan shall be submitted and the test results shall be documented (by reports).

7.10.7.3 Additional documentation may be required for systems of category III. The documentation shall include a description of testing methods and required test results.

7.10.7.4 For wireless data communication equipment, the following additional technical documentation shall be submitted

.1 details of manufacturer's recommended installation and maintenance practices;

.2 network plan with arrangement and type of antennas and identification of location;

.3 specification of wireless communication system protocols and management functions (refer to 7.10.5.3);

.4 details of radio frequency and power levels;

.5 evidence of type testing in accordance with shipboard conditions;

.6 on-board test schedule (mooring trials).

7.10.7.5 Necessary documents for approval of programmable electronic systems of category I shall be submitted if requested.

7.10.7.6 All changes or modifications shall be documented by the manufacturer and submitted to the Register for consideration and approval.

Subsequent significant modifications to the software and hardware for system categories II and III shall be submitted anew for consideration and approval.

Note. A significant modification is a modification which influences the functionality and/or safety of the system.

7.10.8 Tests and evidence.

Tests and evidence (reports, certificates) shall be issued in accordance with Table 7.10.8.

Definitions and notes relating to Table 7.10.8 are given in Appendix thereto.

Table 7.10.8

Tests and evidence according to the system category				
No.	Tests and evidence	System category		
		I	II	III
1	Evidence of quality system Quality plan for software Inspection of components (only hardware) from sub-suppliers Quality control in production Final test reports Traceability of software	M M	M M M M M	M M M C C
2	Hardware and software description Software description Hardware description Failure analysis for safety related functions only		M M C C C	C C C C C
3	Evidence of software testing Evidence of software testing according to quality plan Analysis regarding existence and fulfillment of programming procedures for safety related functions		M	C C
4	Hardware tests Tests according to the requirements of Section 12, Part IV "Technical Supervision during Manufacture of Products" of the Rules for Technical Supervision during Construction of Ships and Manufacture of Materials and Products for Ships		W	W
5	Software tests Module tests Subsystem tests System test		M M M	C C C
6	Performance tests Integration test (with software) Fault simulation Factory acceptance test	M	M W W	W W W
7	On-board tests (mooring trials) Complete system test Integration test Operation of wireless data communication equipment to demonstrate electromagnetic compatibility	M	W W P	W W P ¹
8	Modifications Tests after modifications	M	C/W	C/W
Symbols: M = Certificate of manufacturer submitted on the Register request. C = Certificate of an independent authority considered by the Register. W = Witnessed by the Register representative.				
¹ The scope of survey is subject to special consideration by the Register, taking into account 7.10.2.2.				

APPENDIX

DEFINITIONS AND NOTES RELATING TO TABLE 7.10.8

1 Evidence of quality system.**1.1 Quality plan for software.**

A plan for software lifecycle activities shall be developed which defines relevant procedures, responsibilities and system documentation, including software configuration management.

1.2 Inspection of components (only hardware) from sub-suppliers. Proof that components and/or sub-assemblies conform to specification.

1.3 Quality control in production.

Evidence of quality assurance measures on production.

1.4 Final test reports.

Reports from testing of the finished products and documentation of the test results.

1.5 Traceability of software.

Modification of program contents and data, as well as change of version shall be carried out in accordance with a procedure and shall be documented.

2 Hardware and software description.**2.1 Software description.**

Software shall be described, e.g.:

description of the basic and communication software installed in each hardware unit;

description of application software (not program listing);

description of functions, performance, constraints and dependencies between modules or other components.

2.2 Hardware description.

Hardware shall be described, e.g.:

system block diagram, showing the arrangement, input and output devices and interconnections;

connection diagrams;

details of input and output devices;

details of power supplies.

2.3 Failure analysis for safety related functions only (e.g. failure mode and effect analysis (FMEA)).

The analysis shall be carried out (described) using appropriate means, e.g.

fault tree analysis;

risk analysis;

FMEA or failure mode, effects and criticality analysis (FMECA).

The purpose is to demonstrate that for single failures, systems will fail to safety and that systems in operation will not be lost or degraded beyond acceptable performance criteria when specified by the approved technical documentation.

3 Evidence of software testing.

3.1 Evidence of software testing according to quality plan.

Procedures for verification and validation activities shall be established, e.g.:

methods of testing;

test program producing;

simulation.

3.2 Analysis regarding existence and fulfilment of programming procedures for safety related functions.

Specific assurance methods shall be planned for verification and validation of satisfaction of requirements, e.g.:

diverse programs;

program analysis and testing to detect formal errors and discrepancies to the description;

simple structure.

4 Hardware tests.

Tests will normally be a type approval test witnessed by the Register representative.

Test reports witnessed by a representative of another IACS-member society shall be subject to special consideration by the Register.

5 Software tests.**5.1 Module tests.**

Software module tests shall provide evidence that each module performs its intended function and does not perform unintended functions.

5.2 Subsystem tests.

Subsystem testing shall verify that modules interact correctly to perform the intended functions and do not perform unintended functions.

5.3 System test.

System testing shall verify that subsystems interact correctly to perform the functions in accordance with specified requirements and do not perform unintended functions.

6 Performance tests.**6.1 Integration tests.**

Programmable electronic system integration testing shall be carried out using satisfactorily tested system software, and as far as practicable intended system components.

6.2 Fault simulation.

Faults shall be simulated as realistically as possible to demonstrate appropriate system fault detection and system response. The results of any required failure analysis shall be observed.

6.3 Factory acceptance test.

Factory acceptance testing shall be carried out in accordance with a test program approved by the Register.

7 On-board tests (mooring trials).**7.1 Complete system test.**

Testing shall be performed on the completed system comprising actual hardware components with the final application software, in accordance with an approved test program.

7.2 Integration tests.

On-board testing is to verify that correct functionality has been achieved with all systems integrated.

7.3 For wireless data communication equipment, tests shall be conducted to demonstrate that radio-

frequency transmission does not cause failure of any equipment and does not itself fail as a result of electromagnetic interference during expected operating conditions. Where failure of equipment required for category II or III systems is found, the layout and/or equipment shall be changed to prevent further failures occurring.

8 Modifications.

Modification to approved systems shall be carried out in compliance with 7.10.6.

8 DYNAMIC POSITIONING SYSTEMS

8.1 APPLICATION AND MARKS IN CLASS NOTATION

8.1.1 The present requirements cover the electric and electronic equipment and automated control systems of the dynamic positioning systems (DP-systems).

8.1.2 Observance of the requirements of this Section and applicable requirements of other sections of the present Part is mandatory for ships, which are assigned in compliance with 2.2.9, Part I "Classification", one of the following marks: DYNPOS-1, DYNPOS-2 or DYNPOS-3, added to the class notation.

8.2 DEFINITIONS AND EXPLANATIONS

8.2.1 Single failure in dynamic positioning system means a failure in an active component (thruster, its local control system, power supply generator, automatic control valve) or in a passive element (pipeline, power or control cable, manually controlled valve, etc).

Redundancy of dynamic positioning system means duplication or multiple redundancy of its components, at which an installation consisting of an electric power supply system and thruster units with their individual control systems is functioning under control of a computer-based system in such a way that failure of particular control systems, particular thruster units or components of the electric power supply system does not affect the performance of the task to ensure the ship position keeping.

Dynamic positioning system (DP-system) means a complete installation intended for automatic and remote automated control of thruster units of the ship in order to dynamically maintain position the ship with prescribed accuracy under the action of disturbing environmental forces.

The installation shall comprise at least the following sub-systems:

- electric power supply system;
- thruster (propulsor) units to supply the DP-system with necessary thrust force and direction in order to compensate for environmental factors;
- control system consisting of computer-based system with appropriate software, data displays, a system of external force and ship's position sensors, as well as set-point devices.

Thruster system means a system intended to produce and maintain at each instant of time an appropriate hydrodynamic thrust vector and force

capable of compensating for the environmental factors affecting the ship.

The system shall comprise the following items:

- electric machine thruster units with drive units and auxiliary systems including hydraulic piping and tanks (if any);
- main propulsion plant of the ship and rudders if under the control of the DP-system;
- electric and electronic equipment for individual control of the thruster units;
- manual and automated devices to control jointly all the thrusters; and
- associated cabling connected to all machinery and systems.

Dynamic positioning control system means an electric and electronic programmable system intended to control the thruster units of the ship and comprising the following components:

- computer-based system with associated software and interfaces;
- automated control systems of the thrusters with the use of a single control device (joystick) or several control devices;
- system of the ship's position sensors, sensors to detect action of environmental forces and feedback sensors;
- operator panel system with controls and data displays;
- system to generate parameters of control effects the thrusters exert on the ship and monitoring the ship's prescribed position;
- power, information and control cabling.

Electric power system means a system intended to supply the DP-system under all operating conditions including the emergency ones and comprising:

- prime movers of generators with their associated auxiliaries, devices and piping;
- generators;
- switchboards;
- cabling and cable routeing.

The electric power system may be a specialized as well as a common electric power system of the ship.

8.3 SCOPE OF SURVEYS

8.3.1 The following equipment of the DP-system is subject to survey during manufacture and in service:

- electric machines and electric machine converters and transformers;

- power static semi-conductor converters and transformers;
- switchboards;
- uninterruptable power supply arrangements;
- power and control, including information, cabling, control and monitoring consoles;
- switchgear and control gear and protective devices;
- computer and computer-based systems with software;
- ship's position sensors system;
- other equipment as may required by the Register.

8.4 TECHNICAL DOCUMENTATION

8.4.1 Prior to commencement of survey of the DP-system electric and electronic equipment during manufacture thereof, the following documentation shall be submitted to the Register for consideration:

- the specification with description of the operating principle and justification of the system redundancy level;
- list of equipment used with indication of the devices and units used and their performance data;
- layout of the thruster units and cable routing diagram with indication of methods used for cable installation and penetration through watertight and fire-proof bulkheads;
- general arrangement plans of the control consoles and panels with indication of primary and secondary control stations;
- schematic and functional diagrams for electric power plant control;
- functional diagrams for computerized control system with indication of the inputs and outputs with feedback,
- self-check system and alarm and monitoring system;
- layout and diagram of the ship's position sensors and their connections with control system;
- test programme for control system;
- failure mode effects analysis (FMEA) for dynamic positioning system on the ships with the following marks: DYNPOS-2, DYNPOS-3, added to the class notation;
- list of spare parts.

8.5 DESIGN OF THE DP-SYSTEM, CLASSES

8.5.1 The design of the dynamic positioning control systems shall conform to the general requirements set forth in Section 2.

8.5.2 Where the main machinery (propulsion plant) and rudder system of a self-propelled ship be part of the DP-system, the requirements of this Chapter shall be fully applied thereto, in addition to the requirements placed upon the propulsion machinery and rudder system.

8.5.3 The DP-systems shall be subdivided into classes based on the severity of consequences of a loss of position keeping stability.

8.5.4 Class 1 DP-system, which corresponds by its characteristics to mark DYNPOS-1 in the class notation, is a system with minimum redundancy as indicated in 8.5.8. In this case, the loss of position of the ship may occur in the event of a single failure as stated in 8.2.1.

8.5.5 Class 2 DP-system, which corresponds by its characteristics to mark DYNPOS-2 in the class notation, shall have such redundancy that a loss of position shall not occur in the event of a single failure in any active component of the system. Passive components of the system shall not be considered to fail where an adequate protection from mechanical damages and owing to the component properties is demonstrated confirmed by a certificate of the Register.

8.5.6 Class 3 DP-system, which corresponds by its characteristics to mark DYNPOS-3 in the class notation, shall have such redundancy that a loss of position is not to occur in the event of a single failure in components in the following cases:

- failure in any active and passive component, as indicated in 8.2.1, located in different watertight compartments; or

- failure in active and passive components located in any one watertight compartment, from flooding or fire; or

- failure of active and passive components in any one fire sub-division, from fire or explosion.

8.5.7 For Class 2 and 3 DP-systems, the operator's error or incompetence shall be considered as a single failure and such failure shall not lead to loss of ship's position keeping stability.

8.5.8 Class 1 DP-system shall be designed with redundancy of the following components:

- control systems of the installation (one manual control system and one computerized control system);
- position sensors system.

8.5.9 Class 2 DP-system shall be designed with redundancy of the following components:

- electric power supply system;
- thrusters with their local control systems;
- computerized control system of the installation;
- position sensors system.

8.5.10 Class 3 DP-system shall be designed with redundancy of components as provided for Class 2 DP-system, but in addition, all the redundant

components shall be separated by watertight or "A-60" class fire-resisting bulkheads.

8.5.11 The redundant components ensuring an appropriate reliability of the system shall function continuously or be switched on immediately shall the need arise. Transfer to a redundant component shall be effected either automatically or by simple action of the operator. The transfer shall not cause excessive fluctuation of the positioning conditions.

8.6 ELECTRIC POWER PLANT SYSTEM

8.6.1 The power system necessary to supply the thruster units shall have a sufficient capacity and shall respond in time to power demand changes caused by operating modes needed at the moment.

8.6.2 For Class 1 DP-systems, the power system need not be redundant.

8.6.3 For Class 2 DP-systems, the power system shall be divisible into at least two independent systems, each having a capacity sufficient to ensure all the operating modes of the thruster units. While in use, the power system may be run as a common electric power supply system.

8.6.4 For Class 3 DP-systems, the power system shall have characteristics mentioned in 8.6.3, but in addition, it shall be physically divided by "A-60" class division (bulkhead) into two independent systems. Where the electric power supply systems are located onboard below the operational waterline, they shall be divided by watertight bulkheads. During operation, such systems shall function separately, except for the cases subject to special consideration by the Register.

8.6.5 Where an automated power management system is provided, it shall be designed with redundancy.

8.6.6 The power management systems shall be supplied from both the main and the emergency source of electric power. Where one of the power sources fails, alarm shall be released at the control stations.

8.6.7 The programmable electronic systems (computer-based or microprocessor (PLC) systems) shall be supplied in such a way as to minimize voltage bumps, harmonic interference and to provide protection against erroneous connection (connection with a wrong polarity).

8.6.8 For the DP-systems designed with appropriate redundancy, depending on their class, the following arrangements shall be provided:

.1 the power system shall be equipped with an automatic changeover device to a back-up source having appropriate quality characteristics including those concerning stabilization;

.2 the change-over operations shall not interrupt or disturb procedures essential to the safety of the ship;

.3 particular attention shall be given to:
sufficiency of the accumulator battery capacity,
consistency between the charging facilities and relevant accumulators;
inverter equipment;
load monitoring systems;
protection systems;
earthing systems;
switchgear;

synchronizing devices to provide change-over to back-up energy sources or back-up power supply systems.

8.7 THRUSTERS SYSTEM

8.7.1 Each electric drive of the thrusters shall be power supplied by a separate supply circuits without the use of common feeders or common protective devices and shall be provided with an independent device for emergency shutdown of electric motor actuated from the control station.

8.7.2 Each electric drive shall be provided with its own control system supplied by a separate circuit without the use of common feeders or common protective devices.

8.7.3 Propeller blade position and thrust azimuth (direction) of the rotatable thrusters in the event of electric drive failure shall remain unchanged without marked deviations.

Control of a thruster shall be restored manually.

8.7.4 To eliminate electromagnetic interaction between command signals, feedback signals of the local and electronic (computer-based) DP control systems, the mentioned control systems shall meet the requirements set forth in 2.2, Part XI "Electrical Equipment".

8.7.5 Each electric and hydraulic control system shall be provided with duplicated power supply via separate circuits without the use of common feeders or common protective devices.

8.7.6 Provision shall be made for back-up power supply circuits, which enable the power supply to be automatically changed over thereto, in the event of the main power failure, not only for the control system but also for the power circuit of the thrusters.

8.7.7 The operations to transfer the power supply of control systems from the main feeders to the back-up ones shall not result in loss of power supply to equipment and devices.

8.7.8 The feedback signals of various parameters describing condition of the ship, the information on

the power consumed to maintain position of the ship and some other parameters are the most important. The DP-system shall be able to compare these signals, initiate the alarm system in the event of their faults and continue to maintain position of the ship using feedback signals from other sensors.

8.8 CONTROL STATIONS

8.8.1 The main DP-system control station shall be generally combined with the main bridge control station where the operator has a good view of the ship's exterior limits and the surrounding area.

The panels of the DP-system control consoles shall be fitted with permanent visual alarm and indication of normal operational status of the following sub-systems:

- electric power supply system (number of running generators and converters, their load, availability of back-up sets);

- power thruster system (number of thrusters, operating mode, load, status of local control systems);

- dynamic positioning control systems (status of main and back-up power supply, values and directions of thrust produced by thrusters, with reference to the ship axes, indication of the ship's position on station, status of computer-based system and status of ship's position sensor system, other information needed to ensure safe functioning of the DP-system).

Information regarding other parameters of particular devices and machinery shall be submitted to the operator on demand.

8.8.2 The display switching system and controls shall be designed with due regard to the national ergonomic standards. The thruster control mode shall be selectable by simple actions of the operator and the mode selected shall be clearly distinguishable among the following control modes provided:

- manual remote thruster control from local stations;

- joystick thruster control from main control station;

- automatic (computer) control.

8.8.3 For Class 2 and 3 DP-systems, the controls and electronic control logic shall be such that incompetent or unauthorized actions of the operator cannot cause disturbance of the normal positioning conditions.

8.8.4 The alarm and monitoring system of the DP-system shall meet the general requirements set forth in 2.4.

8.8.5 The alarm system of the DP-system, in addition to audible and visual signals relating to the

DP-system machinery and devices, shall contain textual and graphic information on typical failure of the system components and recommendations to the operator with respect of necessary arrangements to be made in order to keep the position of the ship.

8.8.6 The dynamic positioning control system shall be designed with a logic that would render fault development and transfer from one system to another impossible. The redundant system components shall interact in such a manner that if one of these components fails, it is isolated (disconnected) while the other component is activated. The displays shall represent sufficient visual and audible information on transfer to the back-up component.

8.8.7 The control system shall provide for quick transfer from the automatic to remote manual control of the thrusters using both several joysticks according to the number of thrusters) and a single common joystick. Transfer from the manual to automatic (computer-aided) control shall be effected with similar quickness.

8.9 COMPUTER-BASED CONTROL SYSTEMS

8.9.1 The redundancy requirements shall not be applicable to computer-based systems in Class 1 dynamic positioning control systems.

8.9.2 Computer-based systems in Class 2 dynamic positioning control systems shall be duplicated and independent of one another. Common facilities, such as plant interfaces, data transfer arrangements, data buses and software, including self-checking routines shall not be capable of causing the failure of both systems.

8.9.3 Computer-based systems in Class 3 dynamic positioning control systems shall be duplicated as indicated in 8.9.2, and furthermore, provision shall be made for an independent back-up dynamic positioning control system arranged in a special space separated by "A-60" class bulkhead from the main control station. During normal dynamic positioning control, the back-up system shall be in "hot back-up" state in "on" condition and shall be automatically updated by input data from the position reference system, thruster feedback, etc. Change-over of control to the back-up system shall be possible at all times and shall be effected manually from the back-up control station.

8.9.4 For equipment Classes 2 and 3, the computer-based DP-control systems shall include a software function known as "failure consequence analysis" to verify the ability of the ship to remain in position after failure of the DP-system equipment

and devices, which can bring the installation into the most severe emergency conditions. This analysis shall verify that the thrusters remaining in operation after a typical failure can generate the same resultant hydrodynamic thrust vector and force as required before the failure, under current weather conditions.

8.9.5 Where the "failure consequence analysis" establishes an inability to maintain position of the ship, warning alarm shall be actuated.

8.9.6 For operations, which will take a long time to safely terminate, the "failure consequence analysis" shall include a function, which simulates the thrust and power remaining after the worst case failure, based on manual input of weather trend.

8.9.7 Redundant computer-based systems shall be arranged with automatic transfer of control after a failure in one of the computer-based systems. The automatic transfer of control from one computer-based system to another shall be smooth, without particular disturbing effects on the thrusters while in positioning mode.

8.9.8 An interruptible power supply shall be provided for each DP-computer-based system to provide a minimum of 30 minutes operation following a mains supply failure.

8.9.9 Application programs and database shall be protected against destruction or data loss due to faults in the power supply system, that is they shall be stored in the read-only memory (ROM) or in the memory with continuous independent power supply.

8.10 POSITION REFERENCE SYSTEMS

8.10.1 Position reference systems for Class 1 DP-systems shall be based on the operating requirements with due regard to the acceptable performance characteristics.

8.10.2 For Classes 2 and 3 DP-systems, provision shall be made for at least three independent position reference systems based on different principles, which shall be simultaneously and coordinately available to the DP-control system during operation.

8.10.3 The position reference systems shall produce data with adequate accuracy. Provision shall be made for visual and audible alarm to indicate deviations from true data or excessive degradation of the signals from the position reference systems.

8.10.4 For Class 3 DP-systems, one of the position reference systems shall be connected to the back-up control system and located in a special space separated by "A-60" class bulkhead from the spaces containing other position reference systems.

8.11 EXTERNAL FORCE SENSORS

8.11.1 For the dynamic positioning system, provision shall be made for at least the following sensors to measure effects of forces acting on the ship or the forces themselves:

- heading;
- magnitude of ship motions;
- wind speed;
- wind direction.

8.11.2 For Classes 2 and 3 DP-systems, the external force signals shall come from at least three independent systems for each parameter (e.g. for heading, three gyro compasses shall be provided).

8.11.3 For Class 3 DP-systems, one group of sensors of each type, in addition to the requirements set forth in 8.11.2, shall comply with the requirement for separation thereof by "A-60" class bulkhead from other sensors.

8.12 ALARM AND MONITORING SYSTEM

8.12.1 In addition to the requirements set forth in 2.4, the alarm and monitoring system shall be arranged with facilities to preserve and indicate the "first fault" data.

8.12.2 Monitored parameters of the alarm and monitoring system shall be subdivided structurally into parameters, which to a certain degree are informative, and parameters, which when alarmed require immediate actions to be taken by the personnel. The list of parameters is given in Table 8.12.2.

8.13 CABLE ROUTING AND PIPING OF DP-SYSTEM MACHINERY AND DEVICES

8.13.1 For Classes 1 and 2 DP-systems cable routes of electrical equipment and control systems, as well as hydraulic, fuel and lubricating oil and other piping shall be installed with due regard to the requirements set forth in 16.8.4, Part XI "Electrical Equipment" and Section 5, Part VIII "Systems and Piping".

8.13.2 For Class 3 DP-systems, cables of stand-by electric and electronic equipment and piping of stand-by support systems and control systems shall not be routed together with cables and piping systems of the main equipment through the same spaces (compartments). Such installation may be only accepted in cases when the cables of stand-by equipment run in "A-60" class fire-protective ducts. Cable connection boxes are not allowed in such ducts.

Table 8.12.2

Parameter	Alarm and monitoring system	Comments
Computer-based control system	Failure ¹	Automatic change-over to back-up system
Heading	Deviation beyond permissible limit	—
Position on station	Deviation beyond permissible limit	—
Power supply system	Failure	Automatic change-over to back-up system
Position reference installation	Failure Error Customizing non-conformity	For each position reference system
Gyro compass	Error Non-conformity	Automatic change-over to stand-by compass
Position reference system	Error Non-conformity	Automatic change-over to back-up system
Wind pressure sensor	Error Non-conformity	Automatic change-over to stand-by sensor
Oil pressure in the hydraulic system "Taut wire"	Minimum	The alarm system parameters may be integrated
Oil temperature in the hydraulic system "Taut wire"	Maximum	Ditto
Oil tank level in the hydraulic system "Taut wire"	Minimum	Ditto
Deviation signal of the hydraulic system "Taut wire"	Limiting deviation	—
Total electric power consumption	Excess	Adjustable within 50 — 100 %
Air temperature of the air conditioning system for computers	Maximum	—
Serviceable condition of main units (sub-systems)	Change in state	—
¹ The computer-based system shall be able to use the last information on position in case when one or more position reference systems are failed or not switched on.		

9 POSITION MOORING SYSTEMS

9.1 SCOPE OF APPLICATION

9.1.1 The requirements of the present Section apply to the automated control systems of power equipment of position mooring systems.

9.2 DEFINITIONS AND EXPLANATIONS

9.2.1 Position mooring system means a complex of systems, machinery and equipment intended for the ship's position keeping at predetermined accuracy when exposed to external disturbing forces by means of tensile anchor lines.

9.2.2 Auxiliary thrusters-assisted position mooring means the use the ship's main propulsion plant and thrusters together with the position mooring system.

9.3 CONTROL SYSTEMS

9.3.1 Each anchor winch shall be provided with the independent control system supplied by its own feeder with an individual protective device.

9.3.2 Each winch shall have a control station located so as to provide a good view of the anchoring operations having regard to the laying-out of the anchor by an anchor handling vessel.

9.3.3 Means shall be provided at each anchor winch control station to monitor chain cable/rope tension, the winch load (current) and the length of the chain cable/rope paid out, the chain cable/rope paying out speed.

9.3.4 A manned anchoring operations control station shall be provided with means to indicate chain cables tension, wind speed and direction. Besides, it shall be provided with means of communication between all control stations critical to anchoring operations.

9.3.5 The local and remote control stations shall be provided with the emergency anchor release arrangements that remain operable at the loss of power supply from the main source of electrical power by automatic switching to the standby source of power. The above controls need not be supplied from the independent source of power.

9.3.6 The emergency release arrangements shall actuate at a load equal to the minimum design tensile strength of the chain cable/rope, as well as at the maximum possible angles of heel and trim as regards damage stability and flooding conditions.

9.3.7 The following alarm signals shall be provided at the central and local anchoring operations control stations: on excessive chain cable/rope tension, on decrease of the chain cable/rope tension below the permissible limits.

9.3.8 Alarms shall be provided at the central anchoring operation control station on the ship's leaving the positioning point and on the ship's deviations from the set course.

The possibility shall be provided of the settings adjustment of the alarms actuation within the specified limits. Actuation settings shall be clearly identified. Measures shall be taken against inadvertent/unintended resetting.

9.4 AUXILIARY THRUSTERS FOR ANCHORING SYSTEMS

9.4.1 Where the anchoring systems are used in conjunction with auxiliary thrusters to keep the ship position, their power equipment and control systems are subject to special consideration by the Register.

9.4.2 Applicable requirements for dynamic positioning systems set forth in 8.7 and 8.8 cover also auxiliary thrusters control systems including centralized microprocessor control units.

9.4.3 Input signals fidelity of the auxiliary thrusters control system shall be provided by the signals relevant processing. All errors revealed during the fidelity check shall actuate alarms.

Российский морской регистр судоходства
Правила классификации и постройки морских судов
Часть XV
Автоматизация

Russian Maritime Register of Shipping
Rules for the Classification and Construction of Sea-Going Ships
Part XV
Automation

The edition is prepared
by Russian Maritime Register of Shipping
8, Dvortsovaya Naberezhnaya,
191186, St. Petersburg,
Russian Federation
www.rs-class.org/ru/